



Rhode Island Energy™
a PPL company

Supplement to

Specifications for Electrical Installations

2022

Covering PPL's Service Areas
in Rhode Island (RI)

**Underground Commercial Distribution (UCD)
Installation and Responsibility Guide
Electric Service Bulletin 759B**

TABLE OF CONTENTS

| | |
|--|----|
| UCD Specifications and Installation Guide Acknowledgement..... | 3 |
| 1.0 Scope | 4 |
| 2.0 General Requirements..... | 4 |
| 3.0 Type of Service | 4 |
| 4.0 Plans | 4 |
| 5.0 Permits | 4 |
| 6.0 Easements | 5 |
| 7.0 Responsibility and Ownership | 6 |
| 8.0 Transformer Clearance From a Building | 7 |
| 9.0 Transformer Clearance From Objects..... | 8 |
| 10.0 Transformer Accessibility | 8 |
| 11.0 Transformer Mechanical Protection/Bollards | 8 |
| 12.0 Transformer pad | 10 |
| 13.0 Transformer Secondary..... | 10 |
| 13.1 Transformer Secondary Connections | 12 |
| 13.2 Secondary Bolt Assembly..... | 12 |
| 13.3 Secondary Splice Box..... | 13 |
| 14.0 Transformer Sweep Entry..... | 13 |
| 15.0 Transformer Grounding and Bonding..... | 13 |
| 16.0 Oil Containment..... | 14 |
| 17.0 Riser Pole | 17 |
| 18.0 Heavy Duty Handhole..... | 18 |
| 19.0 Primary Cable Pull/Splice Box..... | 19 |
| 20.0 Trench Requirements | 20 |
| 21.0 Conduit Requirements | 22 |
| 21.1 Pulling Tape | 23 |
| 21.2 Trench and Conduit System Inspection | 23 |
| 22.0 Primary Cable and Electrical Equipment..... | 23 |
| 23.0 Secondary Cable and Conduit System | 24 |
| 24.0 Metering | 24 |
| 25.0 Manhole | 24 |
| 25.1 Manhole Frame Ring and Cover | 26 |
| 25.2 Switchgear Manhole | 26 |
| 25.3 Switchgear Manhole Ground Grid | 30 |
| 25.4 Switchgear Manhole Bollard Layout..... | 31 |
| 26.0 Fiberglass Switchgear Base with Conduit Entry's..... | 32 |
| 26.1 Fiberglass Switchgear Ground Grid | 33 |
| 26.2 Switchgear Fiberglass Boxpad Bollard Layout | 34 |
| Figure 27.0-1 15kV Transformer Pad 75- 500kVA 44-113 (ref-44-113/UF8A) | 34 |
| Figure 27.0-2 15kV Transformer Pad 750- 2500kVA 44-114 (ref-44-114/UF8B) | 36 |
| Figure 27.0-3 25-35kV Transformer Pad 75- 300kVA 44-115 (ref-44-115/UF8C) | 36 |
| Figure 27.0-4 25-35kV Transformer Pad 500- 2500kVA 44-116 (ref-44-116/UF8D)..... | 37 |
| 28.0 Sample Installations..... | 39 |
| 29.0 Bollard Detail..... | 41 |
| 30.0 Concrete Specifications | 42 |
| 32.0 Concrete Approved Precast Manufacturers | 49 |
| 33.0 Approved Material – Underground Commercial Installations | 50 |
| 34.0 Other Materials/ Suppliers | 52 |
| 35.0 Job Check Off Sheets..... | 53 |
| 36.0 Cable Installation Maximum Pull Chart | 55 |
| 37.0 Padmount Compartment Sealing Requirement | 56 |



Rhode Island Energy™

a PPL company

UCD Specifications and Installation Guide Acknowledgement

The requirements and specifications outlined in this guide book must be strictly followed. Any requirements not adhered to can pose safety problems, can be detrimental to the installed system and must be corrected before final acceptance. The customer will bear full cost to make corrections to sub-standard installations.

Customer is responsible to provide enough lead time for the company to design job, provide inspections and install company equipment where applicable. Typical lead times are shown below.

| | Lead-Time | Notes |
|--|-----------|--|
| Design and Layout | 8 weeks | Company receives all required plans, load data, and easement information |
| Pad Inspection | 1 day | Company inspector |
| Trench Inspection | 3 days | Company inspector |
| Company Installation | 4 weeks | After all inspections are approved and permits/easements are procured. |
| NOTE: The above times are estimates only. | | |

Project Title _____

Location _____

Owner/Developer _____

Customers Representative _____ **Date** _____

Company Representative _____ **Date** _____

Specifications Issued _____ **Date** _____

Company's Copy

1.0 Scope

The purpose of this specification is to define, interpret and clarify the scope of work and material dealing with services to padmounted transformers. This specification does not cover any primary metering.

Any reference in this specification to the *Company* shall mean the nationalgrid Company. Any reference to the *Customer* shall mean the *Contractor, Developer or property owner*.

2.0 General Requirements

All electrical wiring to be connected to the *Company* equipment shall be installed in accordance with one or all of the following:

- Local Municipal Inspection Authority
- State's Electrical Code
- National Electrical Code
- National Electric Safety Code
- Applicable Distribution Construction Standards of the *Company*
- RIE's Information and Requirements for Electric Service

There shall be no attempt to deviate from either the Distribution Standards of the company or the *Company* construction plan without the approval of the *Company*. Any specifications noted shall supersede the Information and Requirements Booklet unless otherwise approved by the *Company*.

Often a pre-construction meeting is helpful to all parties to ensure timely completion of the project. The *Company* Business Service Representative will make the necessary arrangements for a pre-construction meeting, or a meeting to discuss changes. *Company* representatives will be available to discuss construction problems when requested or during a field visit.

3.0 Type of Service

Electric service shall be three phase, four wire, 120/208 or 277/480 volt supplied from a padmount transformer to be located on the *Customer's* premises. The primary electrical service to the padmounted transformer will be supplied from a pole or cable system owned by the *Company*

4.0 Plans

When municipal approval is required, the *Company* shall receive final town approved development plans on a scale not less than one-inch equal to one hundred feet prior to engineering construction plans. The property site plan shall show all proposed and existing utilities, i.e. water, gas, sewer, cable television, telephone, etc.

Conduit Systems in general: the *Company* requires a spare conduit for all *Company* owned duct systems, as shown in *Company* plans. The *Company* duct system when required must be in **a separate concrete envelope from all other utilities**. Other utilities must maintain clearances as outlined in the NESC.

5.0 Permits

In general, all applicable permits necessary to trench and excavate, including street openings and wetland permits, shall be obtained by the *Customer* and made available upon request if necessary. The *Customer* shall be responsible for including these padmount and conduit/trench specifications with the wetlands application for developments located in or near wetlands. A copy of the wetlands permit may be requested by the *Company* prior to acceptance of the conduit/trench system by the *Company*.

The excavator doing the excavation shall obtain the required DIGSAFE permits before any excavation may take place in a public way. The *Customer/Company* doing the excavation is urged to obtain copies of the applicable statute and become familiar with its requirements. Similarly, the *Customer/Company* shall determine if the municipality in which the excavation is to be done requires that water, sewer or other utility, municipal or private, be contacted separately.

The *Customer* shall certify to the *Company* that areas in which the *Company* is to perform installation or maintenance work is free of preexisting contamination by hazardous wastes or materials and to indemnify the *Company* for any claims, costs, expensed, suits, demands, citations, fines or damages of any kind arising from the presence of any such contamination.

6.0 Easements

As a condition of service, the Applicant or Customer must provide the Company with an easement(s), properly executed by all owners of record drafted by the Company, for all Company owned facilities located on private property (to include User or Private Roads and Private Ways), whether or not such private property is owned by the Customer. The Applicant or Customer will provide such easement(s) prior to the start of the Company's construction and at no cost to the Company. The Applicant or Customer shall provide a copy of its mortgage and deed, together with a copy of the survey and/or plan of record, for the Company's use in preparation of the easement(s) as well as any other documents necessary for the Company to prepare such easement(s).

Rights-of-Way, Easements

In UCD, URD, or multiple occupancy building applications, the Customer shall provide the Company with two copies of the approved development map, certified as final by a design professional or licensed land surveyor, which the plan shall have been recorded or filed with the Registry of Deeds. The map shall indicate lot lines, building setback lines, grade lines, sidewalk, roadway, sewer, water, drainage, and other facilities. The map shall also include the identification and, where appropriate, delineation of sensitive environmental resources including, but not limited to, wetlands, streams, archaeologically sensitive areas, and hazardous waste disposal areas, etc. In addition to this base information, this map shall clearly indicate the easement strips dedicated to the Company and the location of the lots (units) for which electric service is requested. The governmental authority having control over land use shall approve this map. In addition, when electronic maps are used, the Customer must consult the Company for submittal.

Rights-of-way and easements must be cleared of any obstructions at no charge to the Company. The applicant shall grade the right-of-way or easement to within six inches (150 mm) of final grade before the Company commences construction. The applicant must maintain the Company's clearance and grading requirements.

7.0 Responsibility and Ownership

The division of ownership and responsibility shall be as outlined below by state. Typical installation specifications to reflect installation practices are shown in the back of this guide.

The *Company* will:

Supply, install, own and maintain:
primary cable, CT and PT's, Transformer and Meter.
* Note: *Company* will not install CT's in CT cabinet.

Check the final torque connections to the transformer's secondary bushings.

Own and maintain:
Primary conduit system (installed by *Customer*).
Secondary cable installed by the *customer* from transformer to secondary splice box, where required.

The *Customer* will:

Install, own and maintain:
transformer pad, reinforcement and grounding, oil containment where required by the *Company* or local authority, transformer mechanical protection, secondary equipment (including a secondary splice box if required), connect secondary connectors for the transformer, self-contained meter box where required by the *Company*.


Supply and install to *Company's* specification:
all primary conduits including concrete encasement, steel riser including 90 degree sweep and bonding clamp with tap, secondary cable from transformer to splice box (if required). make up secondary cable ends, including final torque of the secondary cable to transformer.

Note: The *Customer* will be held accountable for any transformer damage occurring due to improper secondary installation.

8.0 Transformer Clearance From a Building

Oil insulated equipment shall be located in compliance with the minimum clearances indicated below. For existing buildings, the transformer shall not block access to existing building systems, such as wall mounted fire sprinkler systems. The building owner's and/or tenants fire insurance carrier or local inspection authority may restrict the proximity of the equipment to doors, windows or combustible materials. It is the customer/developer's responsibility to determine the acceptability of the proposed location of the equipment.

The clearances, line of sight, shall apply to doorways, windows, ventilation ducts and fire escapes.

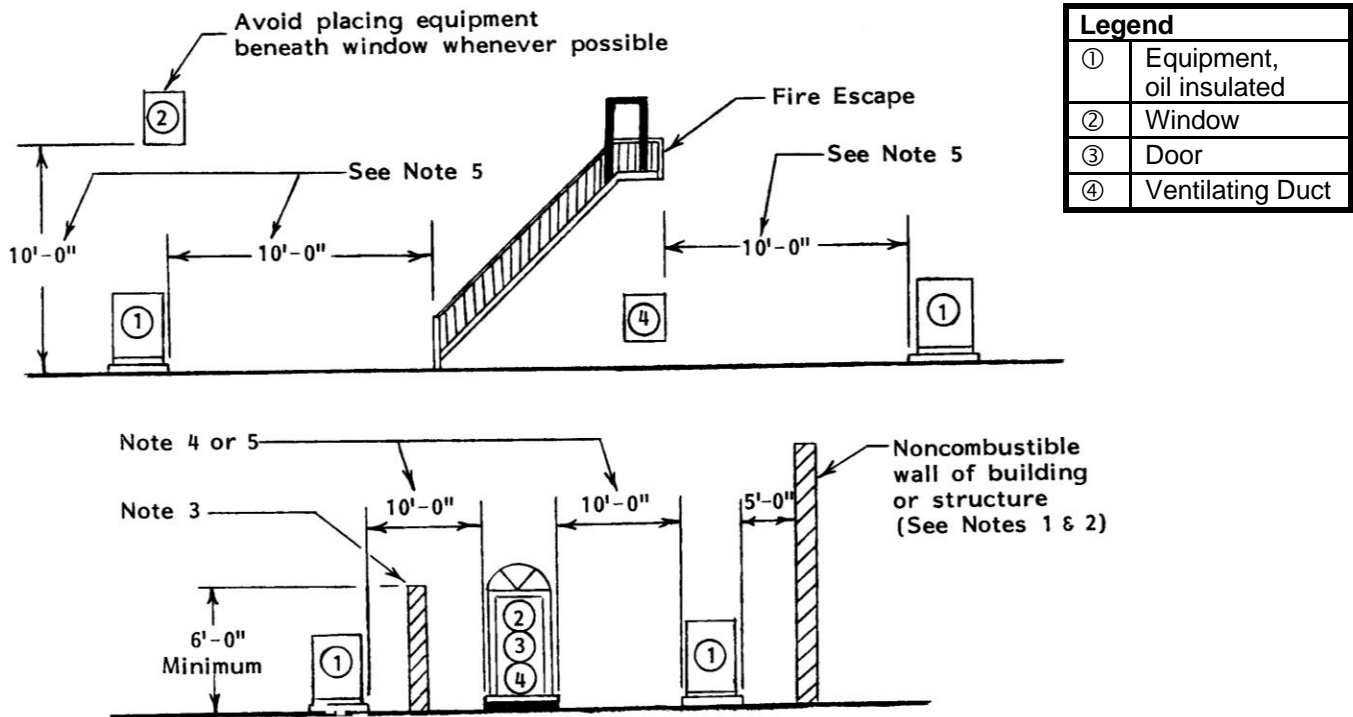

Notes:

1. Noncombustible material is defined as a material that will not ignite, burn, support combustion or release flammable vapors, when subjected to fire or heat, or as described by the latest edition of the NFPA-220.
2. No portion of a building or building structure shall overhang any part of the pad-mounted equipment.
3. In cases where required distances cannot be met, a noncombustible barrier, 6 foot minimum height, shall be constructed. This barrier shall be designed to provide adequate fire protection to the existing structure. A design for this structure shall be prepared and sealed by the customer's Professional Engineer or Registered Architect and shall further be approved by the local authority having jurisdiction of building code enforcement.
4. For exits from a public assembly room, such as an auditorium, a 10 foot minimum clearance should be increased to 25 feet, unless there is a barrier.
5. This requirement may vary between individual states. Refer to the building code regulations for the state involved.

9.0 Transformer Clearance From Objects

Clearances from objects:

- A. An area measuring 10 feet from any point of the transformer pad shall be kept free of all:
- buried water lines, storm drainage lines, gas lines, other electric lines;
 - underground fuel storage tanks; and
 - above grade fire hydrants, cell towers, self contained diesel or diesel byproduct fueled generators, and outdoor enclosed generators.

NOTE: The 10 ft. clearance may be reduced with a noncombustible barrier (see Note 3) and shall not be less than five (5) feet from the edge of the transformer pad. The Customer or their authorized representative shall obtain this clearance reduction approval from the Company and the local AHJ(Authority Having Jurisdiction), as necessary, prior to the noncombustible barrier installation.

- B. An area measuring 25 feet from any point of the transformer pad shall be kept free of all:
- exposed water lines, gas piping, sewer lines;
 - open conductor electric lines; and
 - above grade gas meters or regulator vents, fuel storage tanks or dispensing units, and non-enclosed gasoline/ propane / LP or LNG gas fueled generators.
 - chemical storage silos / tanks.

NOTE: The 25 ft. clearance may be reduced to 10 ft. with a noncombustible barrier (see Note 3) and shall not be less than five (5) feet from the edge of the transformer pad. The Customer or their authorized representative shall obtain this clearance reduction approval from the Company and the local AHJ(Authority Having Jurisdiction), as necessary, prior to the noncombustible barrier installation.

10.0 Transformer Accessibility



Equipment shall be located within 10 feet of a way open to vehicular traffic and a minimum distance from any structure such as poles, fences, etc. as a means to permit accessibility for installation and maintenance. A minimum of 10 feet of clear space shall be maintained in front of the equipment doors to permit installation and removal of separable connectors and fuses with shotgun stick.

11.0 Transformer Mechanical Protection/Bollards

Whenever possible, equipment should be located so it is not subject to vehicular damage. If this is not feasible, adequate guards such as concrete filled pipes (Bollards) shall be placed to protect the equipment.

Bollards shall consist of 6 inch minimum diameter hot dip galvanized or painted steel pipes filled with concrete. When Bollards can not be painted at the time of installation, painted covers shall be installed. Bollards are to be 5 feet above the ground and a minimum of 4 feet below the ground. Bollards to be set in a concrete footing as shown in detail below. Concrete is to be crowned on top of all bollards. Bollards shall be installed with due care to avoid interfering with ground grid and conduits. The number, type (galvanized or steel) and locations of bollards shall be determined by Distribution

Design/Planning, taking into account proximity to traffic and to buildings as well as other barriers to traffic. Other factors such as salt spray and fertilizers may impact type of bollard required. Suggested bollard locations and dimensions are shown below. The location of bollards shall not impede a door opening of 100 degrees.

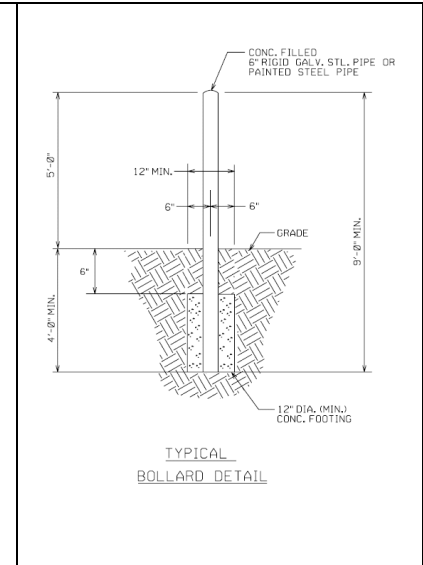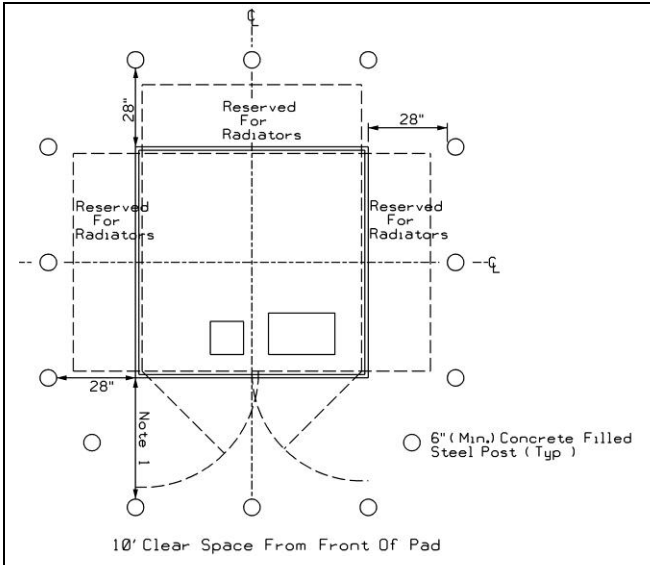

| | |
|------------------------------|---|
| Bollards Required | ● |
| Bollards Not Required | ⊗ |

Notes:

1. Six foot minimum clearance from front of pad.
2. Distribution Design/Planning shall designate the number and location of Bollards by marking the Bollards of this drawing as follows:
3. Bollards shall be supported with a 12" minimum diameter concrete footing 6" below grade to base of the bollard.
4. For installations around oil containment curbs, install bollards six feet minimum on all applicable sides.



Picture of Bollard cover, use for when Bollards can not be painted.

12.0 Transformer pad

The *Customer* shall provide and install a concrete transformer foundation in accordance with the *Company* standards. Precast concrete transformer foundations built to *Company* standards are available from a variety of vendors listed in Section 32. Spec sheets of the different size pads are shown in Section 27.

Cast in place pads shall meet the following specifications. Concrete shall be a Mix M-4, detailed specifications are in Section 30. Reinforcing in pad shall be # 5 grade 60 bars and shall conform to ASTM STANDARD A-615 of latest date. Reinforcing rods are to be located in center of the slab, with a minimum of 2 inches of clearance from face of concrete. All transformer pads must have an adequate base of 2 inches of sand and 12 inches of gravel. The gravel shall be thoroughly compacted and the sand thoroughly wetted immediately before placing the concrete.

The location of the concrete transformer pad, on the *Customer* premises, shall be approved by the *Company* in advance of the construction. The *Company* must, with sufficient notification (24 hours minimum) from the *Customer*, inspect the forming and reinforcing of the pad, the sub grade preparation, and the ground grid **prior** to the pouring of concrete. This requirement is critical. Failure to have inspection done may result in the need to remove and rebuild the concrete foundation

13.0 Transformer Secondary


Size and number of secondary cables shall be in accordance with the NEC and shall be approved by the electrical inspector or AHJ of the town or city involved. Maximum number of secondary cables to be physically connected to the *Company*'s pad-mounted transformer is outlined below:

| | |
|----------------|--|
| 4 Hole Spades | 6 sets 750 kcmil Max. |
| 6 Hole Spades | 8 sets 750 kcmil Max. |
| 10 Hole Spades | 10 sets 600 kcmil or 8 sets of 750 kcmil |

Secondary cable requirements greater than this, will require a separate compartment, handhole, or bus duct.

Secondary cable shall not be installed until pad mount transformer has been set to ensure adequate length of secondary cable and connections.

All acceptable spade terminals are shown in Figures 1, 2 and 3. Minimum terminal thickness is to be ¼ inch, with ⁹/₁₆ inch holes.

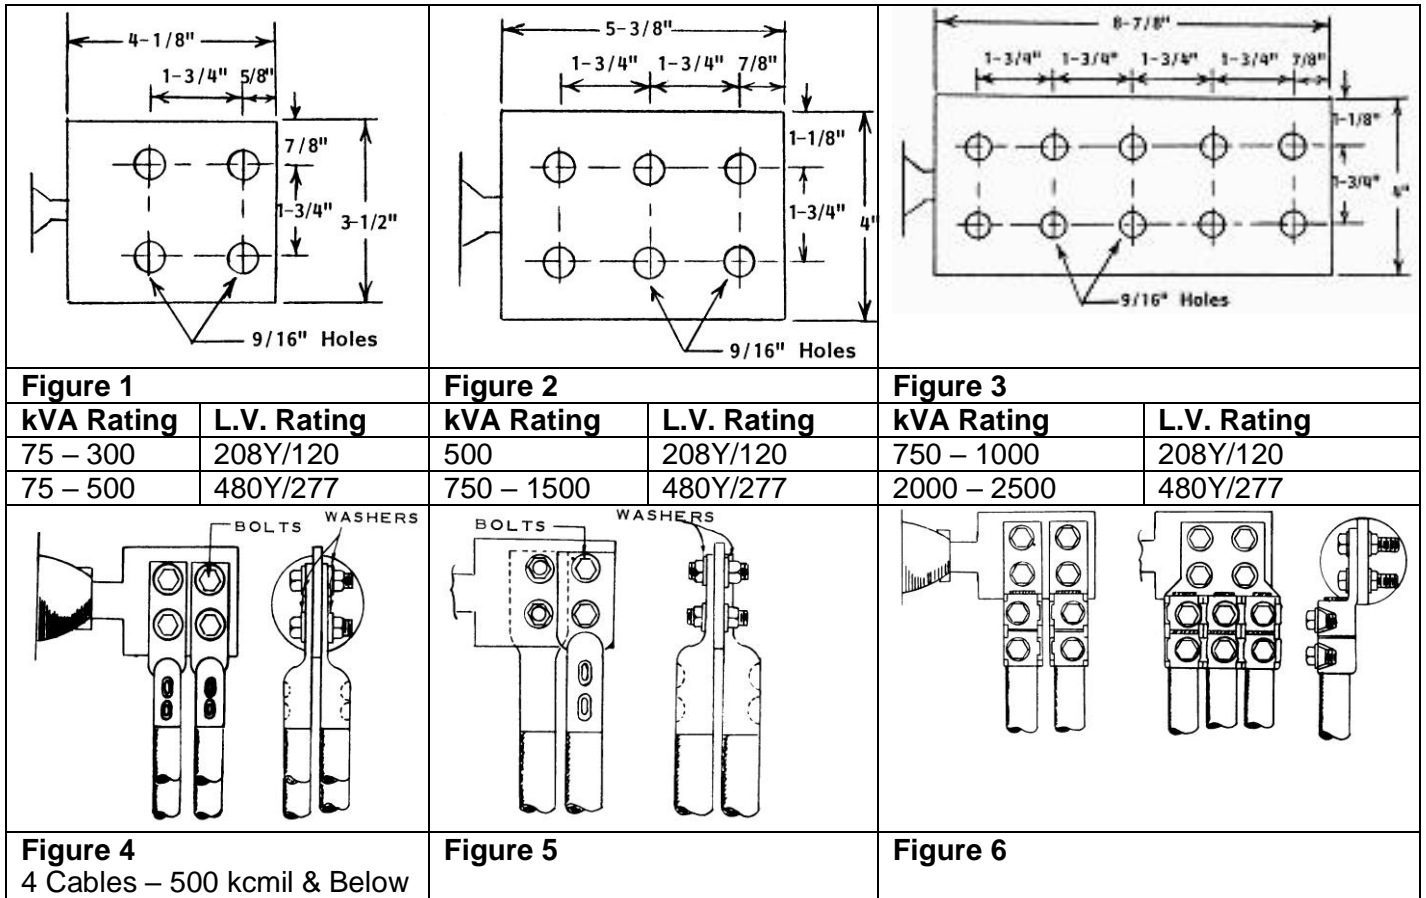

Notes:

- Figure 4 – Compression connections will accommodate up to four cables with a maximum individual lug width of 1¼ inch.
- Figure 5 – Compression connections will accommodate two cables with lug greater than 1¾ inch width.
- Figure 6 – Typical example of bolted connections for two, four or six cables to maximum capacity of lug.
- Metering (CT's) mounted inside the padmounted transformer may reduce the number of sets of secondary that can be installed by blocking off some holes on the secondary spade. In some cases the customer may be required to purchase a secondary splice box.
- A list of a few manufacturers that supply the connectors is located in Section 34.


13.1 Transformer Secondary Connections

All connectors and connector fasteners shall be furnished, installed, owned and maintained by the customer/developer. Connectors shall be approved by the Company prior to purchase. Final electrical connection to the transformer secondary terminals shall be inspected by the Company. The customer/developer shall make all final connections to the spades of the padmount transformer to a final torque of 40 foot pounds. Size and number of secondary cables shall be in accordance with the NEC and shall be approved by the electrical inspector or AHJ for the town or city involved.

13.2 Secondary Bolt Assembly

The customer/developer shall supply and install aluminum connectors for use with aluminum cable, or copper connectors for use with copper cable. Tin plated connectors can also be used as an alternate connector for aluminum and copper connectors. Connector shall be a cable to flat clamp or compression type connector, with a minimum of two holes in the flat pad and two clamping elements or two compressions per cable, and must be approved by company representative. Bolts and flat washers shall be grade 304 stainless steel. Belleville washers shall be grade 301 stainless steel. Nuts shall be waxed grade 316 stainless steel.

- A. A flat washer is placed between the concave side of the belleville washer and the surface of the member being joined. The belleville is thus captured between the head of the bolt and the large flat washer. The flat washer should have an outside diameter greater than the flattened belleville's such that no overhand results. Select a flat washer that is twice as thick as the belleville for strength. (If not available, stack two or three thinner washers to achieve the same effect).
- B. With the belleville washer captured between the flat washer and the bolt head, fit the assembly into its hole. When the washers are fitted in position, there should be no interference with washers of adjacent bolts and no overhang over surface edges.
- C. Tighten the nut on the bolt (with a washer of its own) until a sudden, noticeable increase in torque is required to continue. The belleville washer is now flat. It is not necessary to "back off" the nut after tightening to this point.

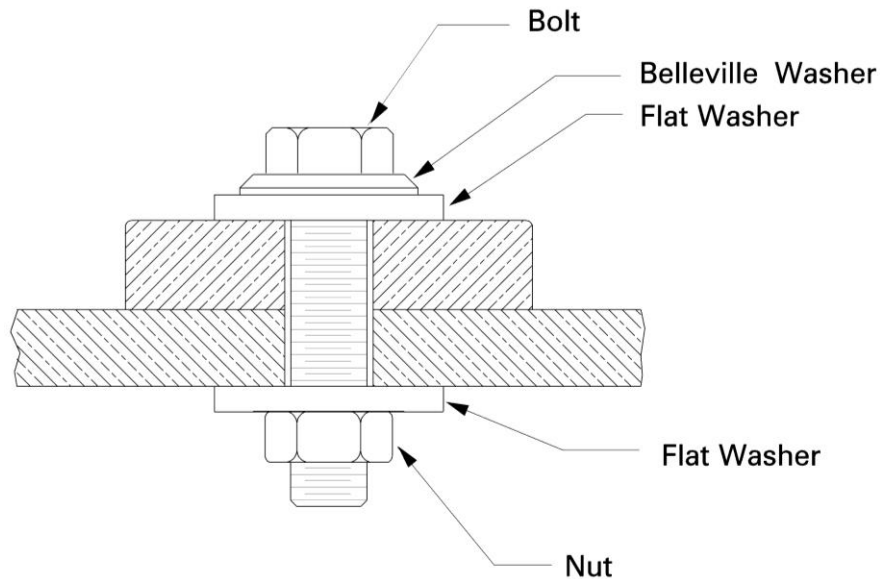

13.3 Secondary Splice Box

A secondary splice box may be required where the customer's number of secondary cables exceeds the maximum allowed amount on the transformer. Supplying and installing this box is the *customer's* responsibility. The cables from the transformer to this box are to be specified by *company's* representative. The *customer* is responsible to supply and install the cables.

Once the service is energized the *company* will take over ownership of only the secondary cables from the transformer to the secondary splice box.

A list of a few manufacturers that supply the secondary splice box is located on Section 34.

14.0 Transformer Sweep Entry

Conduit shall be installed as shown in Section 28 before slab is poured. Use 36 inch radius sweeps, with couplings, nipples and bushings as required. Sweeps for primary cables shall be galvanized steel or PVC. Conduits shall be raised a minimum of 1 inch approximately over the concrete slab. Expanding foam Hilti Inc. CF810 shall be used to fill inside the conduits after the primary/secondary is installed. Ownership of cable will determined who installs the foam on each cable. After pulling tape is in, install the expanding foam in any spare/empty conduits. Place a rag into empty conduits prior to the foam as a support for the foam while curing takes place.

After the concrete pad is cured, the remainder of the conduit primary and secondary openings through pad will be sealed with grout. Before sealing steel sweeps, the sweeps must have a bond clamp attached with a #4 Cu tap to connect to the ground grid. Fill the conduit primary and secondary openings with sand (no aggregate) to a grade of approximately 2 inches below the top of the concrete pad. Place a layer of concrete grout (no aggregate) 1 to 2 inches thick on top of the sand layer to seal the conduit entrance. Do not cover the conduit ground clamps with grout. The expanding foam may be used as an alternate for filling in the opening with sand and concrete grout. Ownership of conduits and pad will determine who seals openings. See Section 37 for further details in *company* bulletin 09-09 Three Phase Padmounted Transformer Sealing.



**Expanding Foam
CF810 available at
Hilti Inc. 1-800-879-8000
Stuart C Irby Co 1-315-453-2970 and 1-315-329-0038**

Spare conduits can also be sealed with conduit plugs, see Section 33 for a list of manufacturers.

15.0 Transformer Grounding and Bonding

The ground grid shall be 2/0, bare, soft drawn, 19 strand copper wire. The wire shall be installed 12 inches below finished grade and located around the transformer pad. Bond to all exposed metallic conduit and leave 3 feet of wire above pad for grounding transformer, one lead in the primary conduit window opening and the other lead in the secondary conduit window opening.

Two 5/8 inch diameter, 8 feet long copper weld ground rods and approved connectors shall be installed to 12" below finished grade. Leave the ground rods and grid exposed until inspected the Company. The ground grid is to be complete and backfilled prior to energizing the transformer. Connections to ground grid to be made as shown on Details A and B below, except that exothermic welding ("cad weld") shall be an acceptable alternative to a compression connection. Bolted connectors are only acceptable for the ground grid connections to the ground rods. The *company* will install the ground taps onto the transformer.

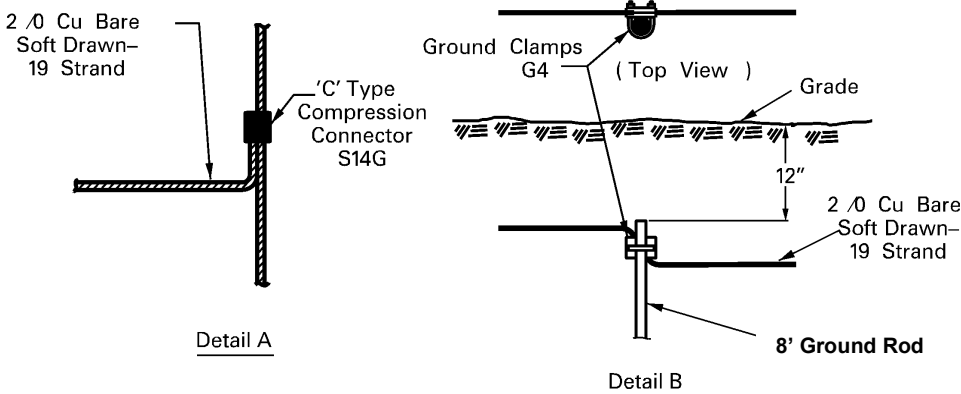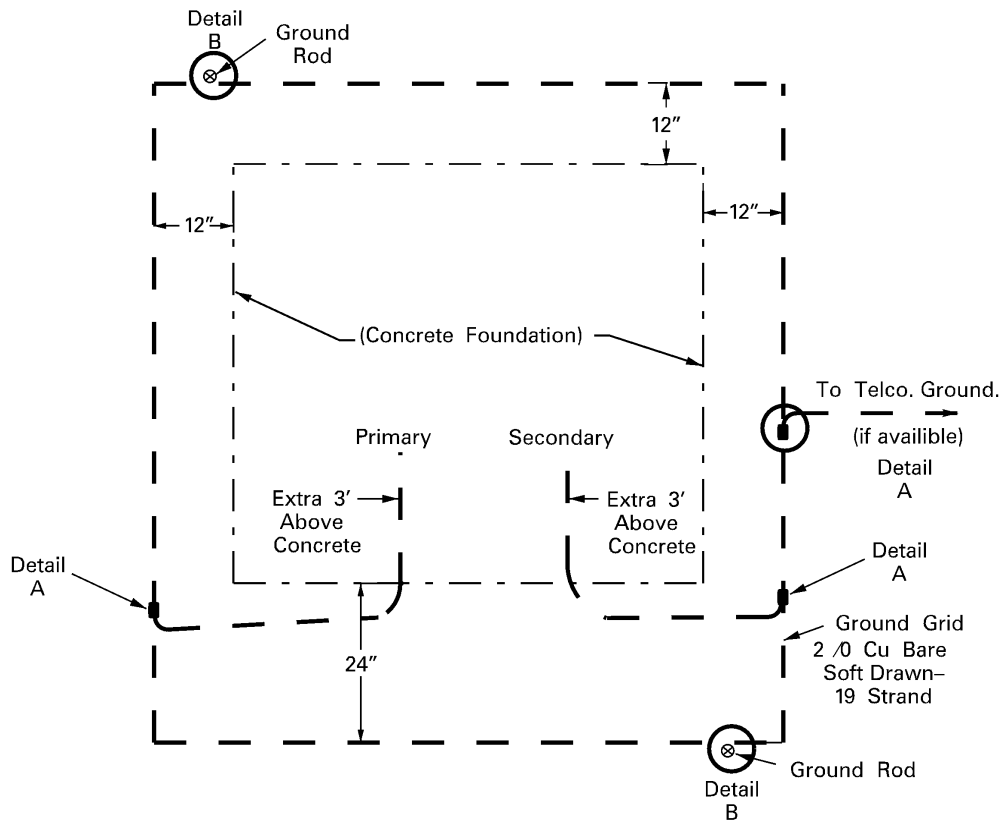

16.0 Oil Containment

This is to be used where oil containment is required by local authorities or where otherwise justified. This liner system will significantly slow the migration of oil into the under laying sub grade, allowing additional time to initiate a cleanup response. The polypropylene geotextile allows the passage of water but absorbs small quantities of oil. This design is intended to confine 100% of total transformer oil present, with a 20% reserve margin, for up to 36 hours. If additional confinement is desired consult the *company* Environmental Engineer. Follow the following installation steps. A precast containment barrier is available as an alternate to casting one in place, check with the precast suppliers in Section 32 for availability. Precast curb can be one piece or made up of separate pieces assembled in the field.

Note: on field assembled pieces. All pieced must be sealed together with rope tar, rubber sealant or

equivalent.

- 1) Build oil curb, this should be installed with concrete in accordance with Mix #4 per concrete specifications in Section 30. Reinforcement to be #4, grade 60 rods minimum, 6 inches on center, bend rods around corners. Curb to be 24" deep with a minimum thickness of 6".
- 2) Install geotextile liner from top of walls and around bottom of containment area. Areas where conduit crosses overlap liner around conduit and seal with expanding foam.
- 3) Install 6" of silty sand on top of liner.
- 4) Install second layer of geotextile liner as noted in step 2.
- 5) Build up area for transformer pad with 6" of compacted gravel and level.
- 6) Install ground grid.
- 7) Set/build transformer pad.
- 8) Fill in conduit openings with silty sand or expanding foam up to the last two inches of the pad
- 9) Fill rest of conduit opening with concrete grout or expanding foam.
- 10) Fill area between slab and curb with 1½ inches uniformly graded crushed rock.

Geo-textile Liner

Generic name is: 16oz polypropylene geotextile also called filter fabric weighing 16oz/sqare yard.

Brand names / Suppliers are:

AME1680 available from American Engineering Fabrics (AEF), Inc.

(Emphasize polypropylene not polyester)


New Bedford, MA@1-617-965-0007 / 1-800-770-2666 or from

Vellano Bros. Lancaster NY 1-716-684-7222, several other locations in NY, MA, RI and NH, go to www.vellano.com


Synthetic Industries ST 160 available from Spartan Mills Inc's, Spartanburg, NC @ 1-803-576-2353

Carthage Mills FX-160HS / US Construction Fabrics LLC 90 Range Rd, Windham NH 03087
1-603-898-0532

Containment Area Plan View

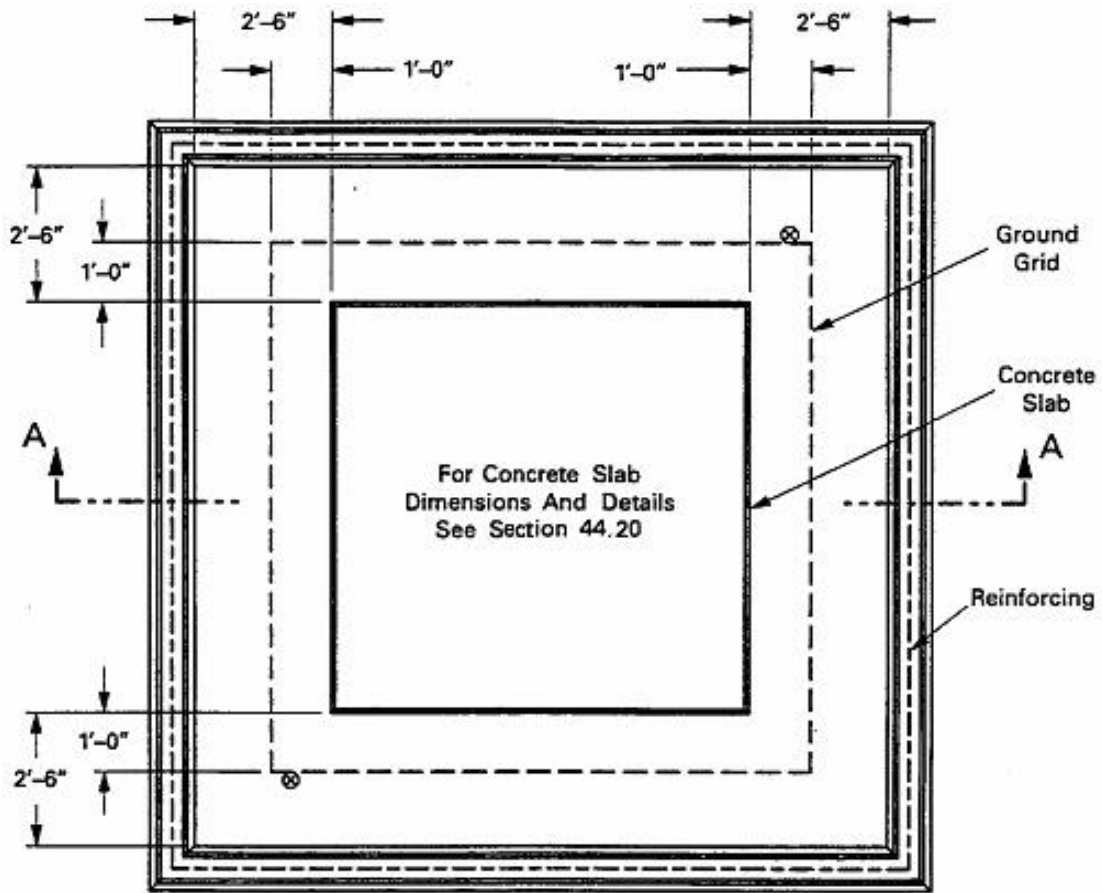

Typical Cross Section of Containment Pad A-A

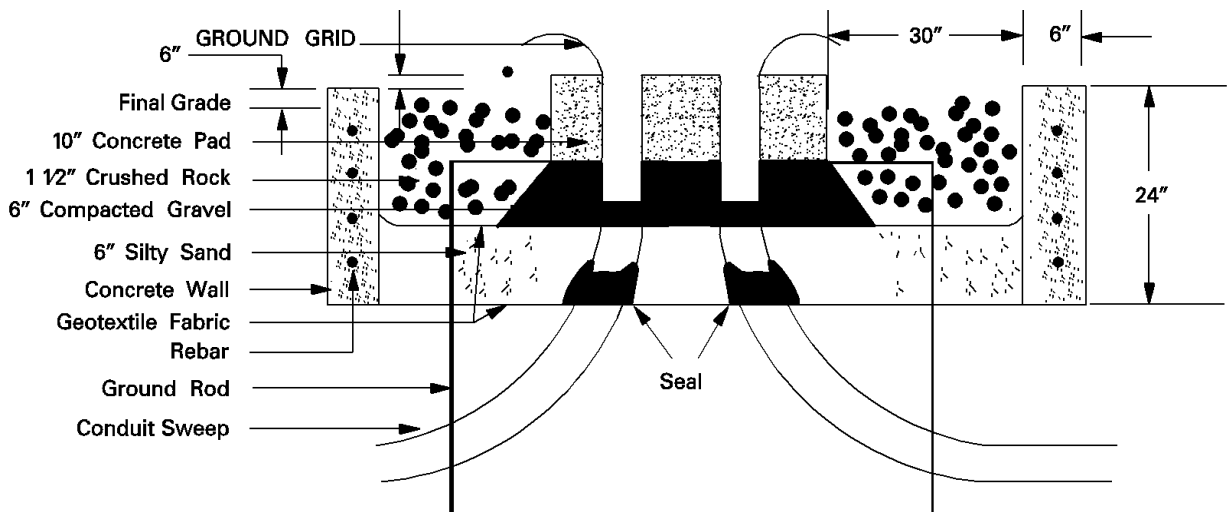

17.0 Riser Pole

The Company shall designate conduit riser locations on the pole. All primary risers shall be Galvanized Steel, this includes the 90 degree sweep. Per NESC all steel risers must be bonded 6" down from top of riser and the bond must be at least 8' high from finished grade.

The Customer is responsible for providing and installing the bond clamps and the tap. The Company will make the bond connection from that riser bond tap to the ground system on the pole. Spare riser sweep shall be bonded also. Riser sweep in Direct Buried applications shall be concrete encased. Approved materials reference is located in Section 33.


NOTE #1 U-Guard

NOTE #2 Galvanized steel conduit and bend are to be used, they shall be grounded by bonding to an approved U-bolt type ground clamp 6" (150 mm) from top of the conduit. A 24" (600 mm) conductor shall be provided to extend to the Company's grounding conductor. The conductor shall be sized as required by the National Electrical Code, Article 250, but in no case shall it be smaller than #4 AWG copper. Recommend use of corrosion resistant bend in locations subject to highway salting.

NOTE #3 Galvanized steel conduit, galvanized steel sweep, attachment clamps, grounding clamp and 24" grounding conductor shall be furnished and installed by Customer. Normally, the conduit shall rise on the side of the pole away from traffic up to 8 ft. (2.5 m) to 11 ft. (3.4 m). Consult company for proper location on pole.


NOTE #4 Pipe straps, install at not more than 30" (750 mm) intervals.

NOTE #5 The conduit burial depth shall be 30" (750 mm) minimum.

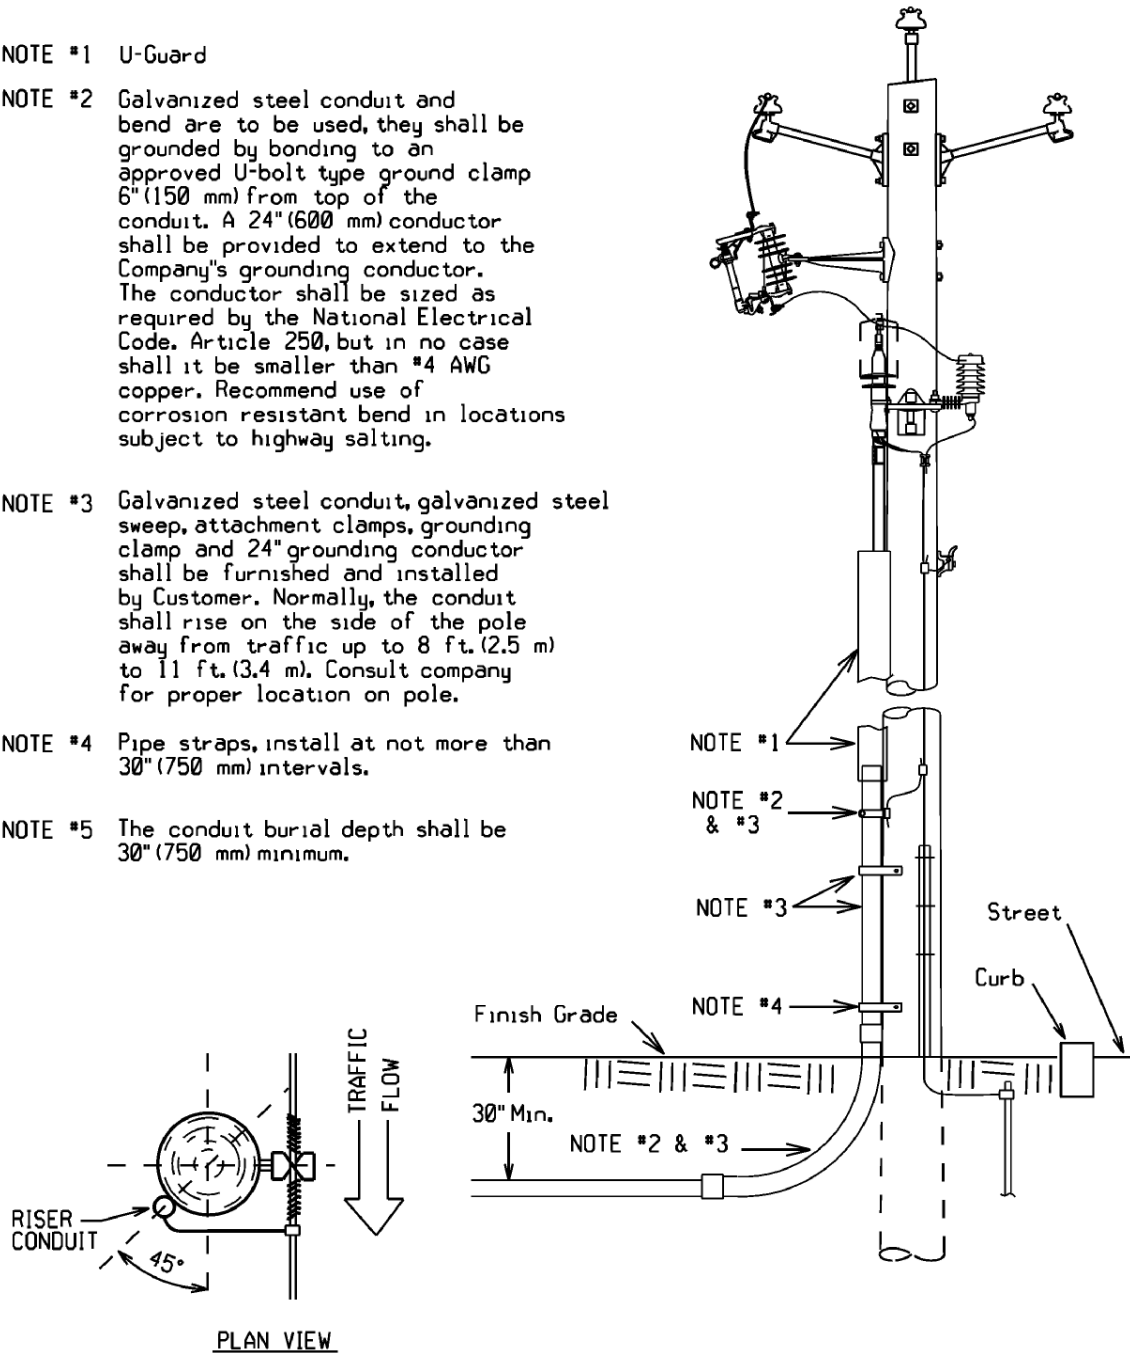

18.0 Heavy Duty Handhole

This primary conduit handhole may be specified in the design for installation in roadways or sidewalks areas where duct length requires extra pulling locations. Heavy duty handholes are supplied and installed by the *Customer*.


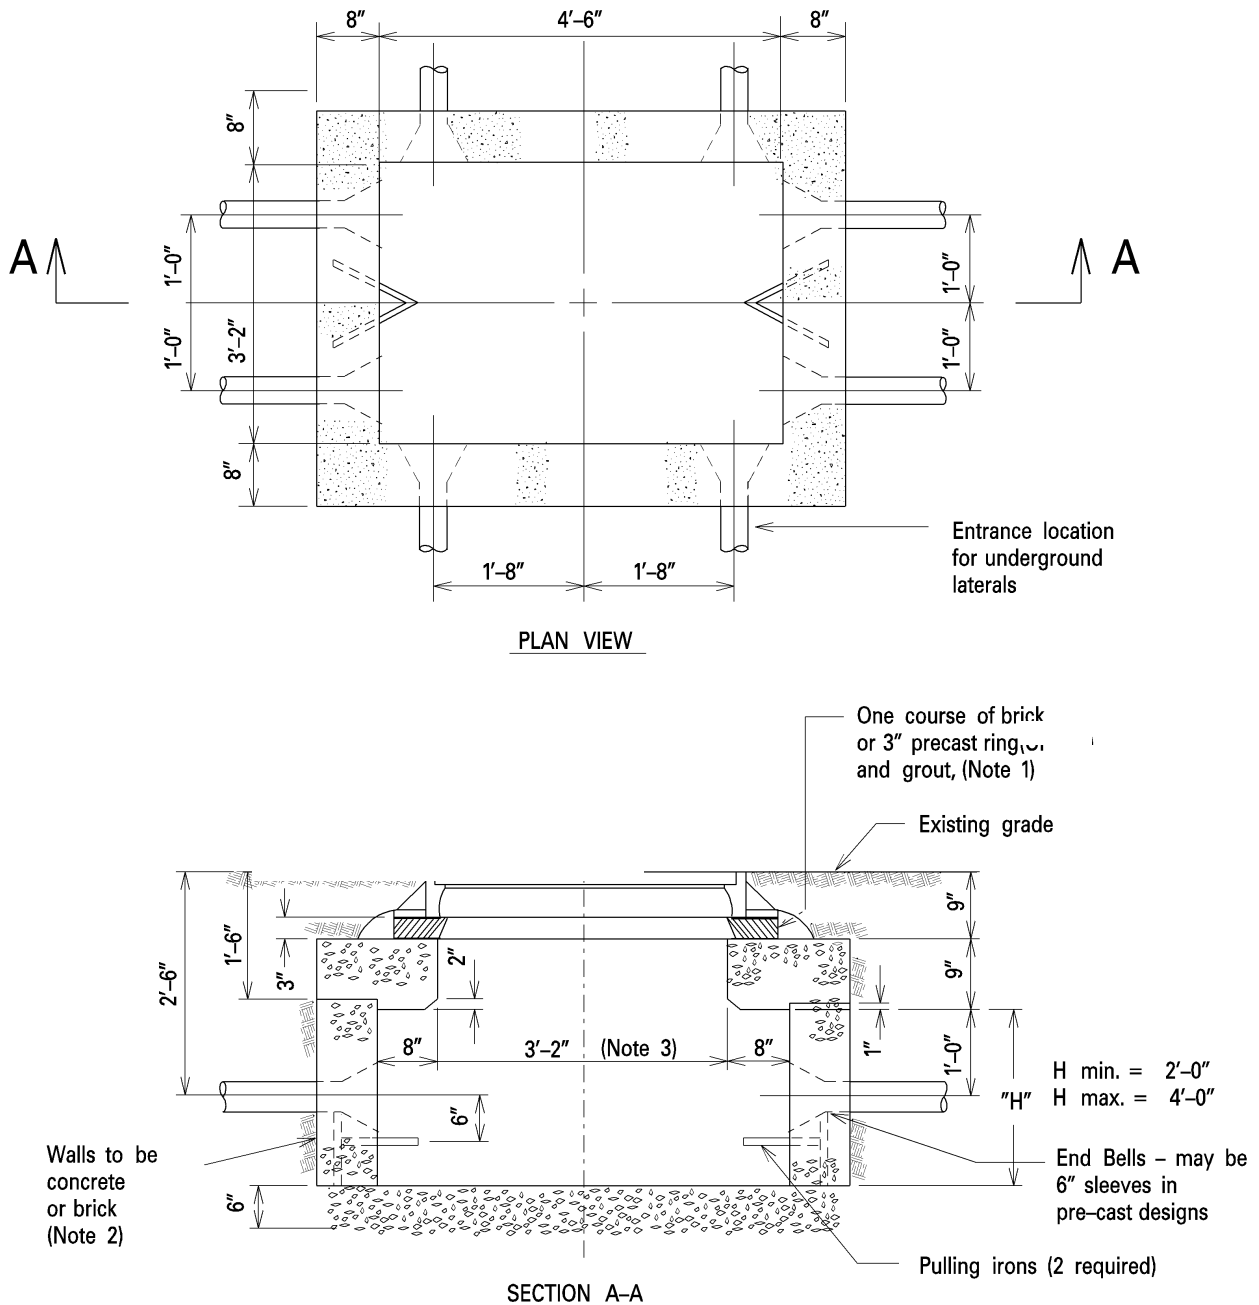


Notes:

1. Chimney height is kept to a minimum to facilitate placing completed splices in handhole from above grade.
2. Concrete minimum strength - See Section 30.
3. Roof opening 3' 2" inches x 3' 2".
4. Handhole frame, ring and cover are typically provided by the *customer*.

19.0 Primary Cable Pull/Splice Box

This primary conduit Pull/Splice Box may be specified in the design for installation in sidewalks or grass plot areas where duct length or design requires extra pulling locations or splices. The splice box is H20 rated and shall be installed in locations not frequently traveled over by vehicles. Pull/splice boxes are supplied and installed by the customer.

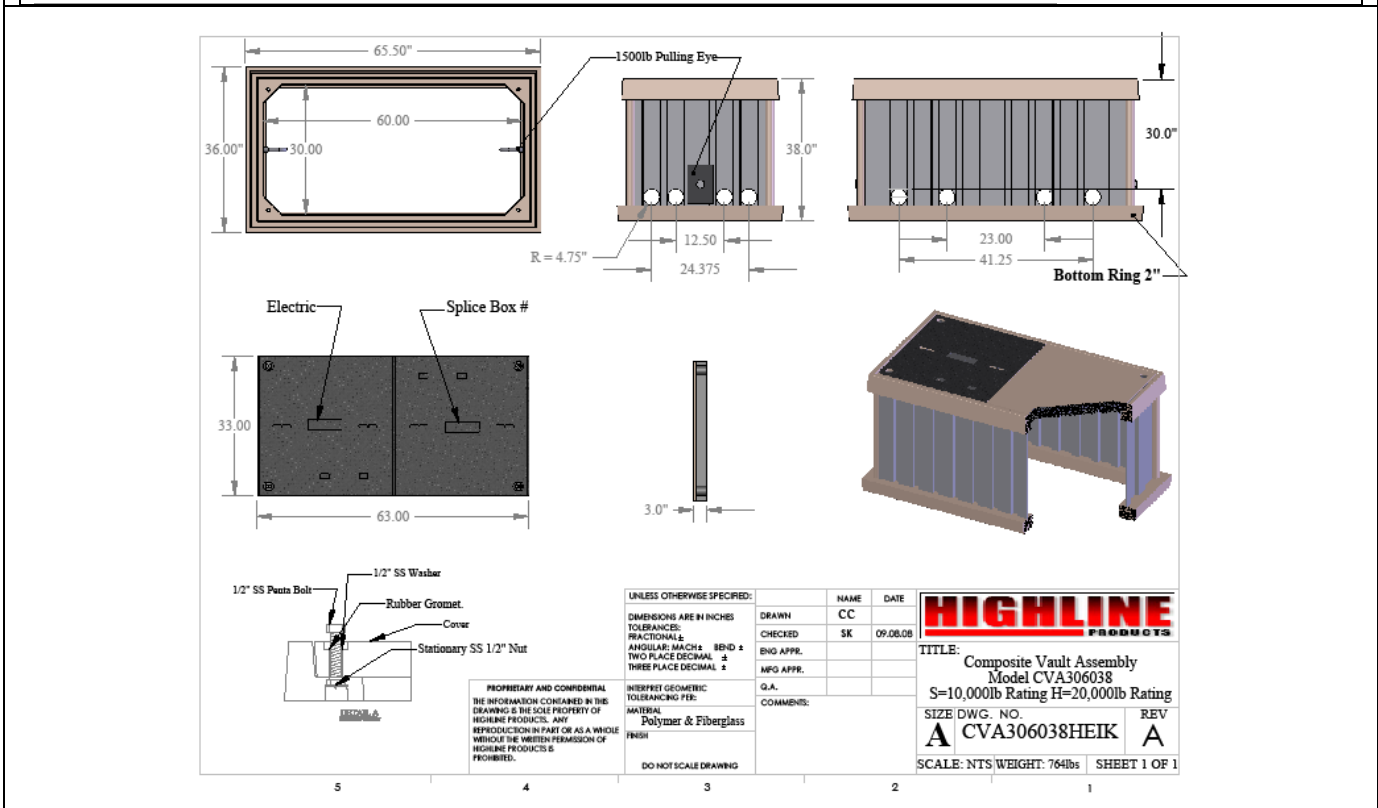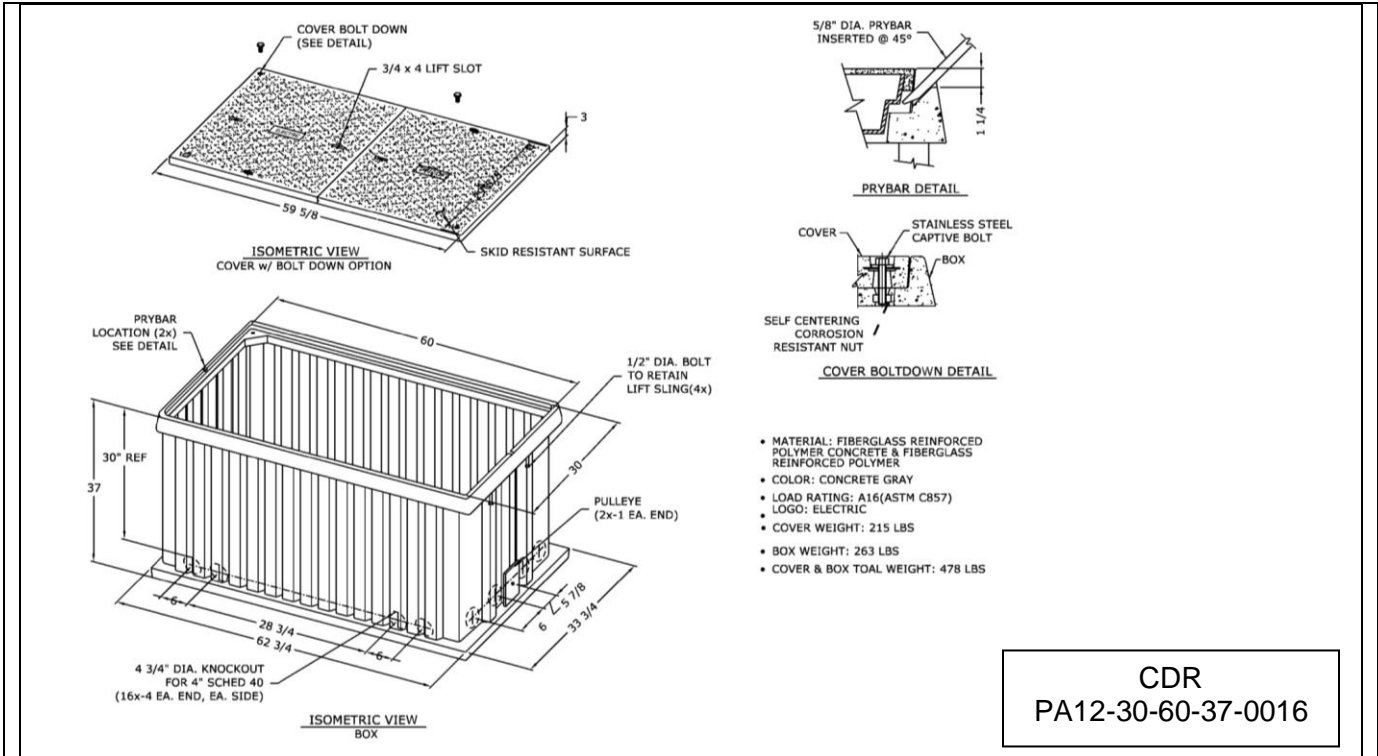

20.0 Trench Requirements

Final grades shall be established; the surface rough graded with in 6" from finished grade, roadway and property boundaries shall be staked or marked by the *Customer* before any trenching is started. Trench spoils shall be kept a distance of 2' minimum from excavated trench.

The *Customer* shall adhere to the construction plan and specifications specifying trench locations, trench depth and concrete encasement. Any deviation shall be subject to approval by the *Company*.

The *Company* shall be notified in advance of the backfilling of any electric facility (e.g. concrete, conduit, manholes, riser bends). The *Company* reserves the right to require re-excavation of the conduits and foundations if the *Customer* fails to have inspection done or backfills before inspection.

Trenches shall not be backfilled until concrete has set (for at least two hours) and until after approval by authorized *Company* personnel. Note: if trench is subjected to traffic then the trench shall set for at least twelve hours. All backfill shall be sand or gravel containing stones less than 1" in any dimension. Backfilling shall not take place over any open-ended (unplugged) conduits. *Company* approved red "Warning" tape shall be installed directly above the *Company's* cable eight to twelve inches below finished grade. Laying the warning tape directly on the cable, concrete or conduit is not acceptable. Certain installations in the public way may require flowable fill instead in place of normal backfill.

Trench Depth / Concrete Encased Conduit

Burial depths for electrical conduit shall be maintained not less than 30" from the top of the concrete encasement to grade during all phases of construction. The trench bottom shall be solid, undisturbed earth. Earth showing signs of peat, cinders, rubble, or any conditions not suitable for a stable foundation shall be reported to the *Company* for recommendation. Small pockets of unsuitable soil shall be replaced with compacted gravel (max. 2" stone). At riser pole end concrete encasement just before riser sweep.

Typical Trenches

| Conduit Trench | Conduit in Concrete Trench |
|---|---|
| | |
| Direct Burial Trench | Legend |
| | <ul style="list-style-type: none"> Base Spacer Intermediate Spacer Primary Electric Duct Communication Duct or Cable Spare Duct Direct Burial Concrete Sand |
| <p>Notes:</p> <p>1) If more than one set of primary is installed in the trench, separate primary by 6" minimum.</p> | <p>Warning tape, provided by <i>customer</i>.</p> |

21.0 Conduit Requirements

The *Customer* shall be responsible for all trenching, excavating, backfilling, and installation of the primary duct system. Exceptions to this shall be in areas where there is an existing manhole and duct system and the limits of trenching by the *Customer* shall be determined by the *Company*. The *Customer* is also responsible to supply and install any necessary manhole, pullboxes, heavy duty handholes, frames and covers. Concrete encasement shall be provided and installed by the *Customer* as specified by the *Company*.

The *Customer* shall ascertain the requirements of the specific municipality in which the development is located. For example, some municipalities may require that the *Customer* employ a licensed electrician to direct the installation of all conduit intended for electric facilities.

Temporary mechanical protection over buried conduit and encasements is recommended to prevent crushing or damage during construction. This is the *Customer's* responsibility.

All road crossings shall, when practical, be perpendicular to the sidelines of the road.

The minimum size conduit shall be 4". All sweeps at foundations and risers shall have a minimum radius of thirty-six inches (36"). The riser sweep shall be galvanized steel. The padmount transformer sweeps shall be galvanized rigid steel or PVC, with the transformer sweeps rising typically 1" above the concrete pad. The *customer* shall install bell ends on the conduits. The *Customer* shall install conduit plugs in all unused conduits and pulling tape. At the riser pole, the galvanized rigid steel sweeps and the PVC/steel adaptors shall not be concrete encased. The *Customer* shall be responsible to install rigid galvanized steel straight conduit up the pole, including conduit ground straps, up the riser pole (unless directed otherwise by the *Company*). The *Company* will specify on which quarter of the pole the riser shall be installed, usually away from oncoming traffic.

Except as noted on construction prints, curves and bends in conduit shall be gradual, and the radius of curvature shall not be less than forty feet. All curves shall be formed with 5-degree couplings. The minimum length between single, 5-degree couplings is 42". Heat bending is not allowed.

Conduit grade shall be such as to cause all ducts to drain toward one or both equipment foundations or pullboxes. Minimum pitch shall be three inches (3") per one hundred feet (100').

The *Customer* shall insure that clearances are met and maintained, and that they are inspected by the *Company*. Unless local jurisdictions require greater clearances, the minimum clearances shall be as follows:

Communication Systems – *Company* conduit shall not be directly above or below communication conduit, except when crossing below communication conduit at approximately right angles. *Company* conduit and communication conduit shall be separated by a minimum of 3" of concrete encasement.

Water, Gas, Sewer – *Company* conduit shall not be directly above or below these utilities, except when crossing above these utilities at approximately right angles. Where the paths of these utilities cross under *Company* conduits at approximately right angles, the minimum separation is 12". A minimum separation of 24" shall be maintained between parallel placement of any of these utilities and electrical conduit.

A 6-inch clearance shall be between conduit envelopes and major subsurface pipes (e.g. drainage pipes).

The *Customer* shall mandrel all primary conduits to insure their integrity **before** the *Company* shall attempt to pull any primary cable. The *Customer* shall furnish and install an approved synthetic, 2,500 pound test tape in each primary conduit run including risers. Pulling tape installation and mandrilling the duct shall be witnessed by the *Company*.

***Company* owned duct shall not share a concrete encasement with foreign utilities (e.g. do not place communication or private electrical duct in the same concrete encasement as *Company* duct).**

21.1 Pulling Tape

All conduits shall have a pulling tape, also known as "Mule Tape". This tape is to be to be rated for 2,500#. Manufacturers of this tape are listed in Section 33.

21.2 Trench and Conduit System Inspection

In the applicable area, a designated *Company* inspector shall be responsible for the inspection of the trench and or conduit system being prepared and installed by the *Customer*, at various stages of installation. The *Customer* shall provide the *Company* inspector with a minimum of 24 to 72 hours notice. Required inspections are:

- 1) After conduit, ground system, reinforcing bars and forming are completed; but before concrete is poured.
- 2) After concrete is poured but before backfilling.
- 3) After backfilling.

The inspection shall not be limited to the above.

22.0 Primary Cable and Electrical Equipment

The majority of installations will have the *Company* provide, install, and maintain the entire primary electrical system including the transformer, cable, cable accessories, terminations, and other miscellaneous primary electrical system components.

In some areas the *Customer* will provide and maintain the entire primary electrical system. The *Company* will provide install and maintain the transformer and other miscellaneous primary electrical system components.

The designation and location of the riser pole(s) shall be determined by the *Company*.

The location of primary cable pull/splice boxes and/or heavy duty handholes shall be determined by the *Company*.

At those locations where manholes or above ground switchgear are required, additional specifications will be provided by the *Company*.

23.0 Secondary Cable and Conduit System



Secondary cables shall be installed underground in customer/developer furnished, installed, owned and maintained conduit system or raceway. Conditions requiring more secondary cables than the Company's transformer secondary terminals can accommodate may require the customer/developer to supply an intermediate splice box to make a transition from National Electrical Code required cable capabilities (required to match main switch), to actual load cable capabilities. Section 33 lists manufacturers of the splice box.

24.0 Metering

Refer to the *company* specifications for the type of installation. Division of work and material will be performed with the approval and authorization of the *Company* Metering Services.

25.0 Manhole

Manhole installation may be required as part of the infrastructure to serve certain customers. The *Customer* shall provide and install the manhole to company specification. Section 32 lists precast concrete providers. Please contact the *company* if details are needed for specifications of manholes.

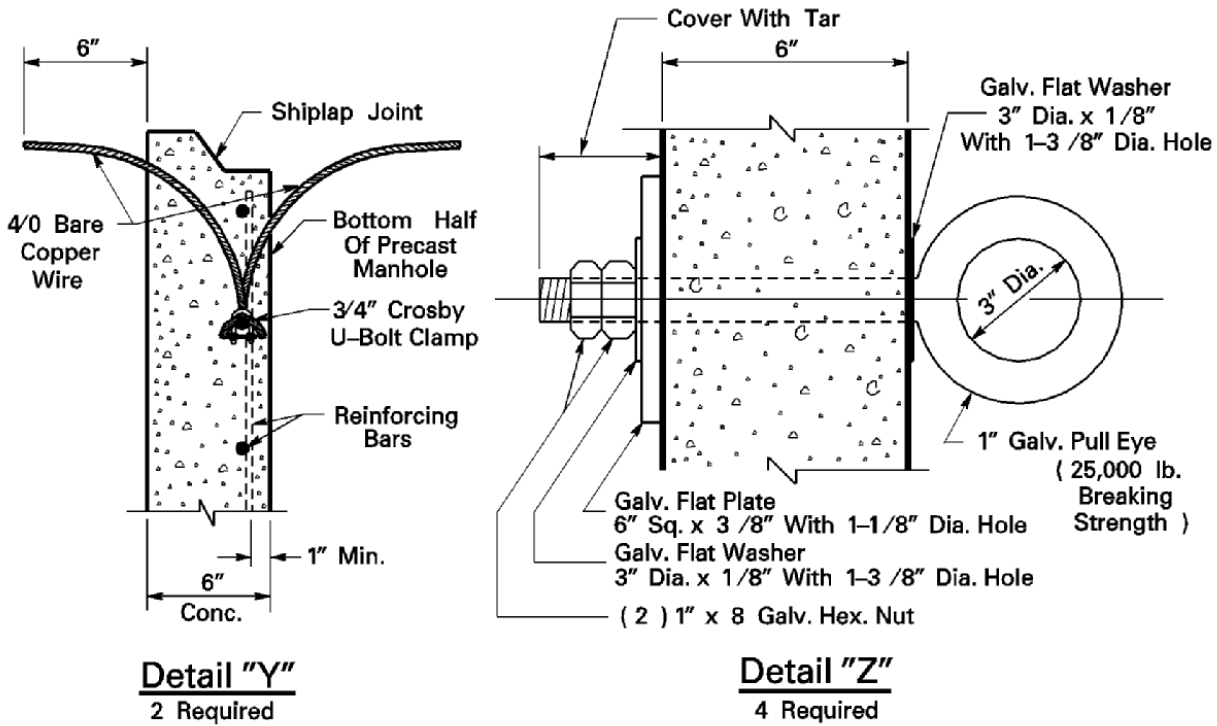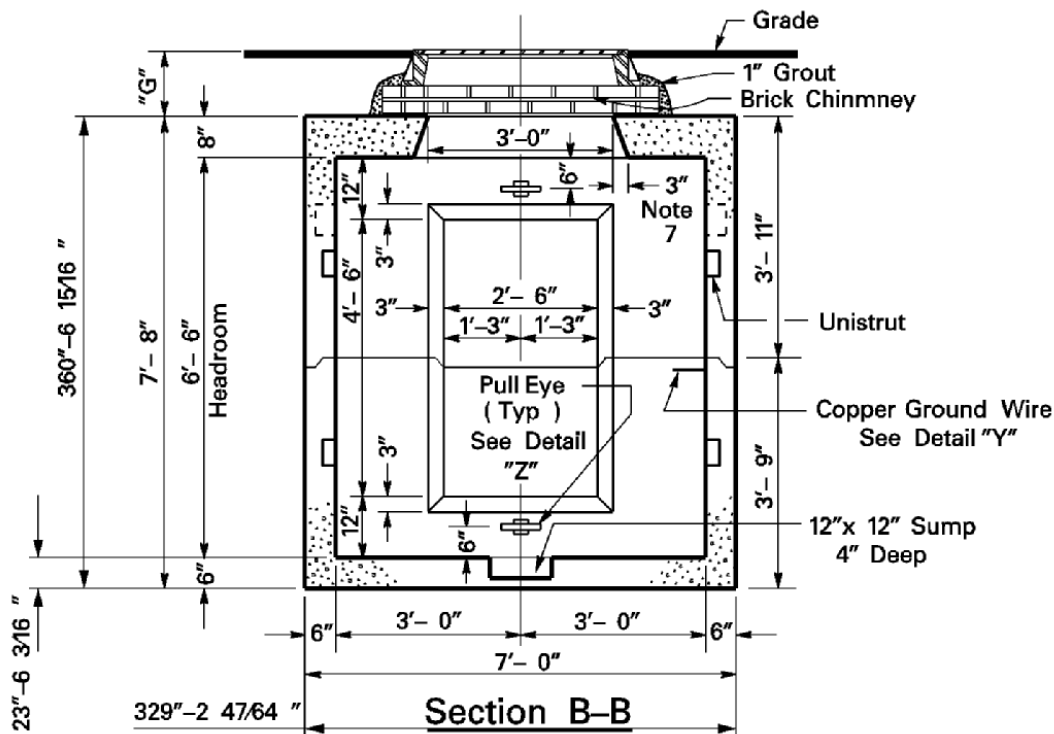

Note: Construction joint to be sealed with asphalt or equivalent.


25.1 Manhole Frame Ring and Cover

The *customer* shall be responsible for providing and installing the manhole frame ring and cover to finished grade. Approved frame, ring and covers are shown in Section 34. Frame shall be installed on a chimney at least 6" in height. minimum. The maximum allowable chimney shall be 36" from the top of the roof of the manhole to finished grade.


25.2 Switchgear Manhole

Switchgear installation may be required as part of the infrastructure to serve certain customers. The *Customer* shall provide and install the switchgear manhole to company specification. Section 32 lists precast concrete providers. The *Company* shall identify which collar shall be used from the choices below.


STD Item
UM20__

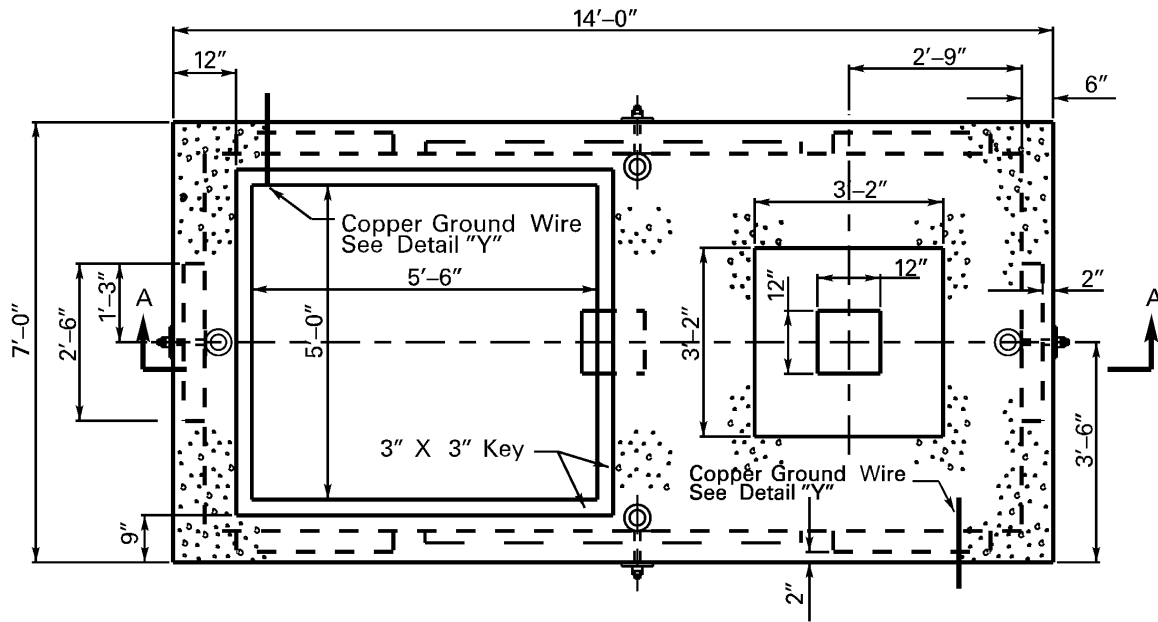


Plan View

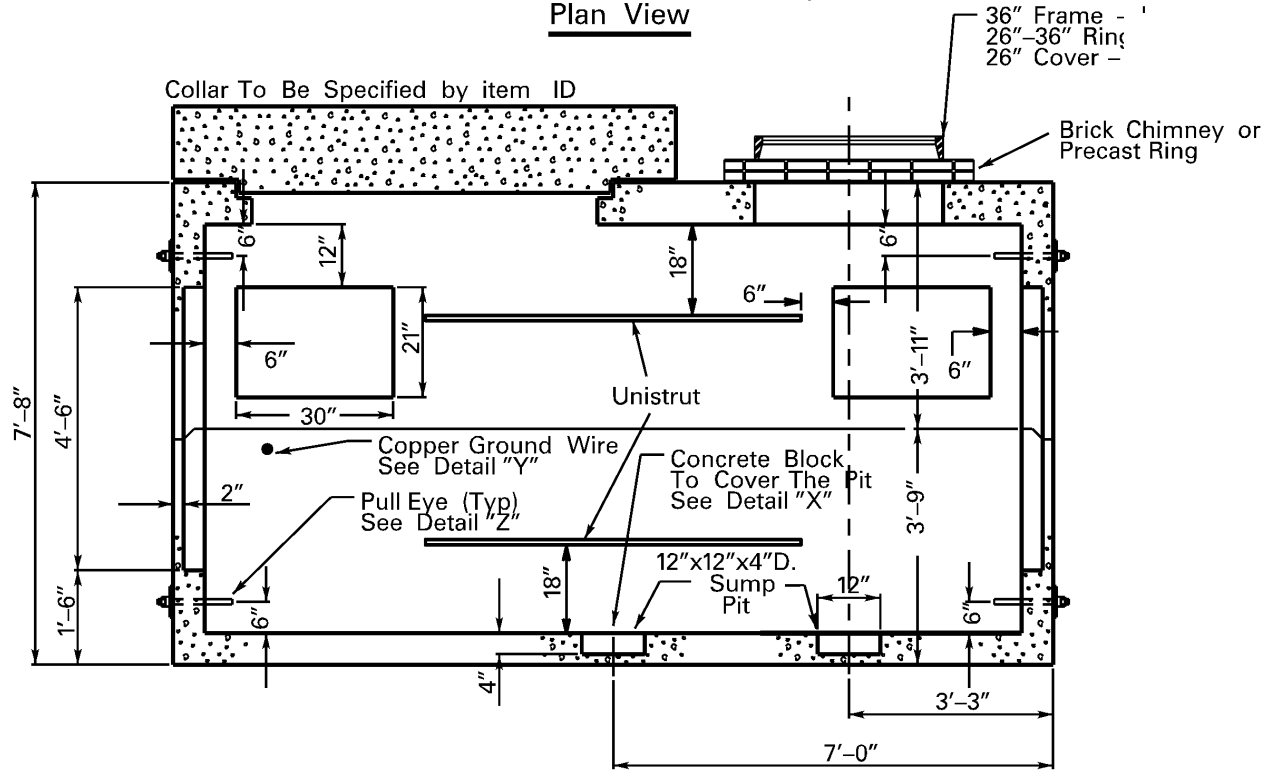

Section A-A

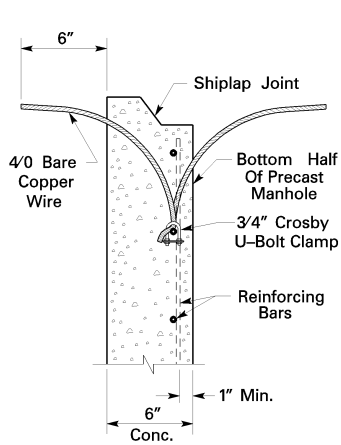


Detail "Y1"
2 Required

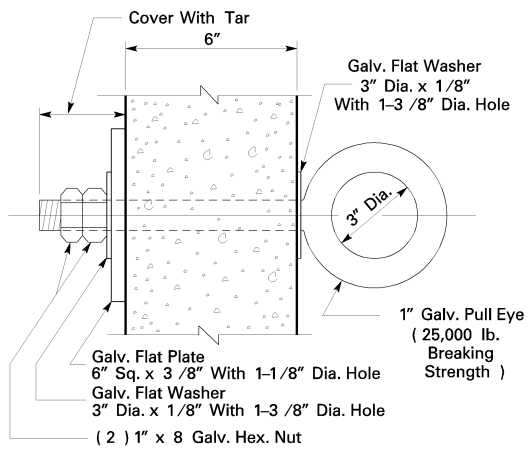


Detail "Z"
8 Required


Switchgear collars

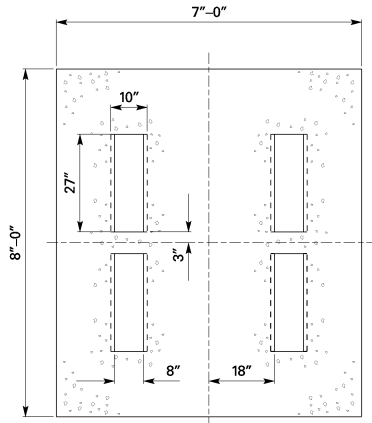


Collar "A"
15kV S/G Collar

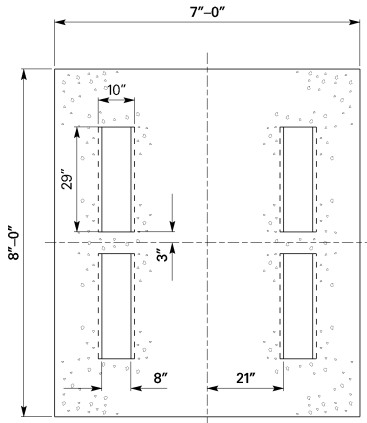


Collar "B"
25/35kV S/G Collar

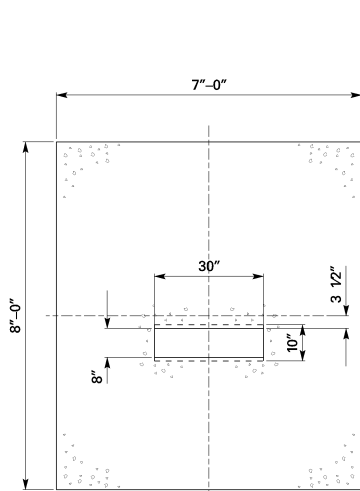


Collar "C"
PWVE Cooper Recloser

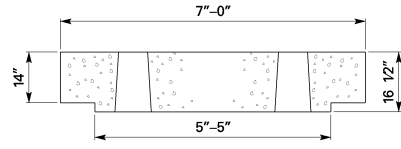



Collar "A"

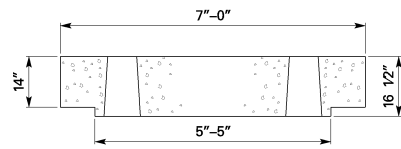

Collar "B"

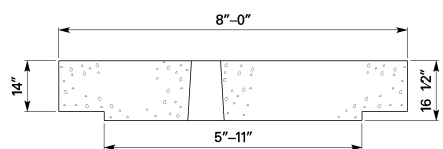

Collar "C"

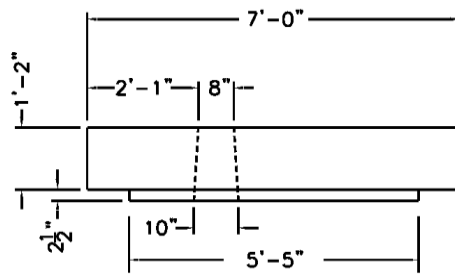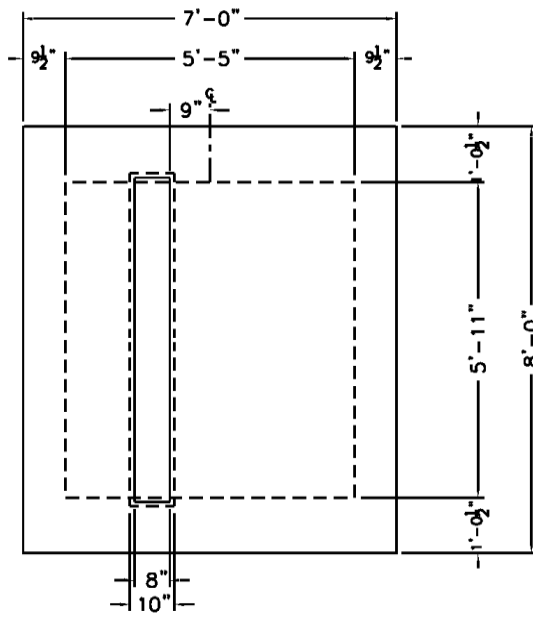

Collar D
35kV Vista Gear 3 AND 4 WAY

25.3 Switchgear Manhole Ground Grid

The Customer shall install the ground grid for a switchgear manhole installation as shown in the picture.



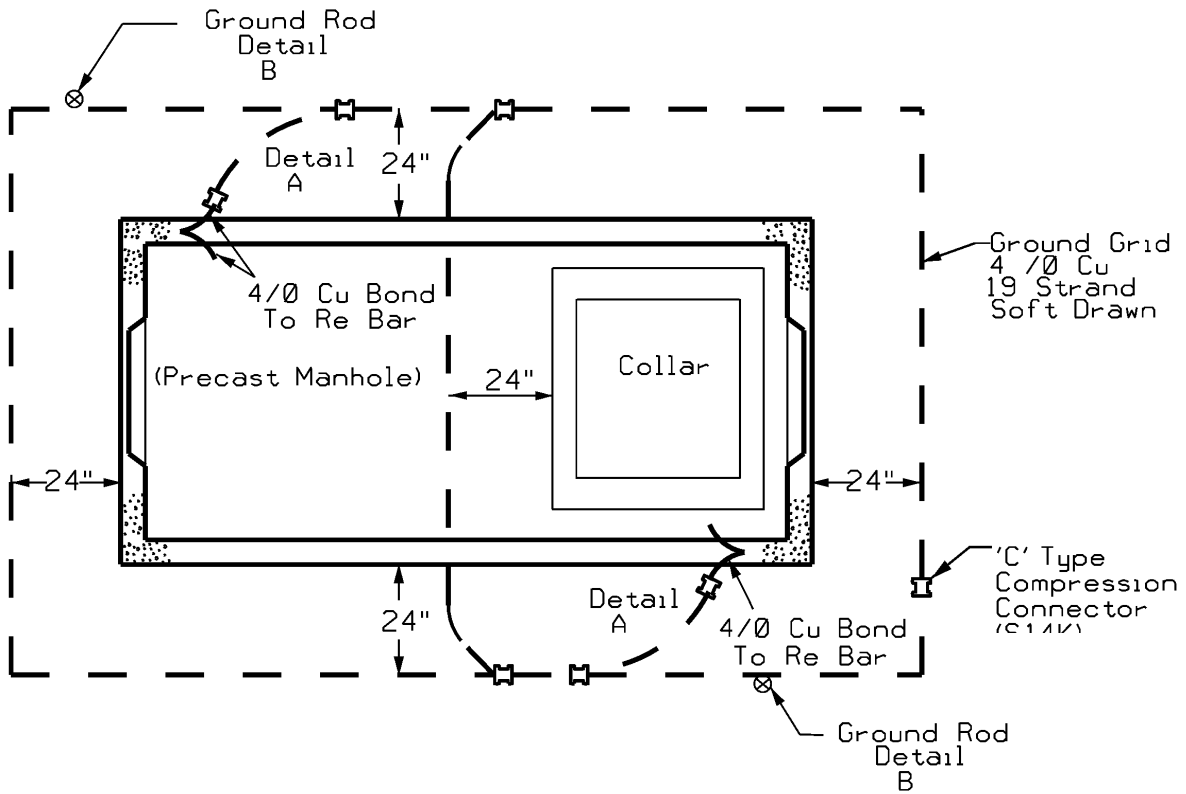


FIG. 1 - PLAN

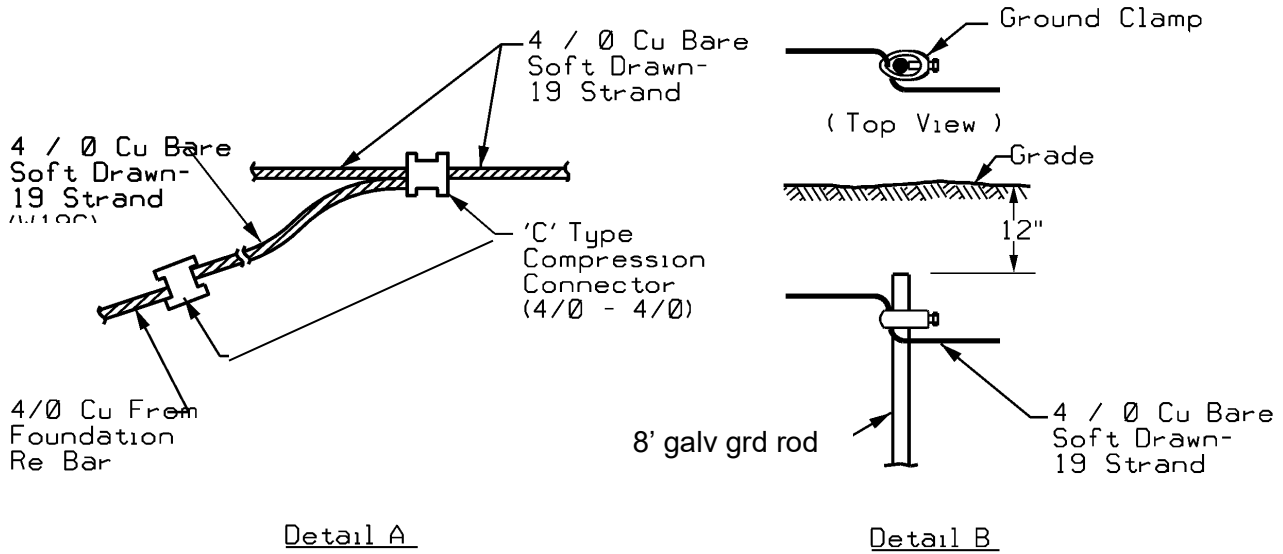

25.4 Switchgear Manhole Bollard Layout



The drawing below depicts the locations for bollard installations around a switchgear manhole. Distribution Design/Planning and or company inspector shall designate the number and location of required bollards for each job. Refer to Transformer Mechanical Protection/Bollards in Section 11 for more details on bollards.

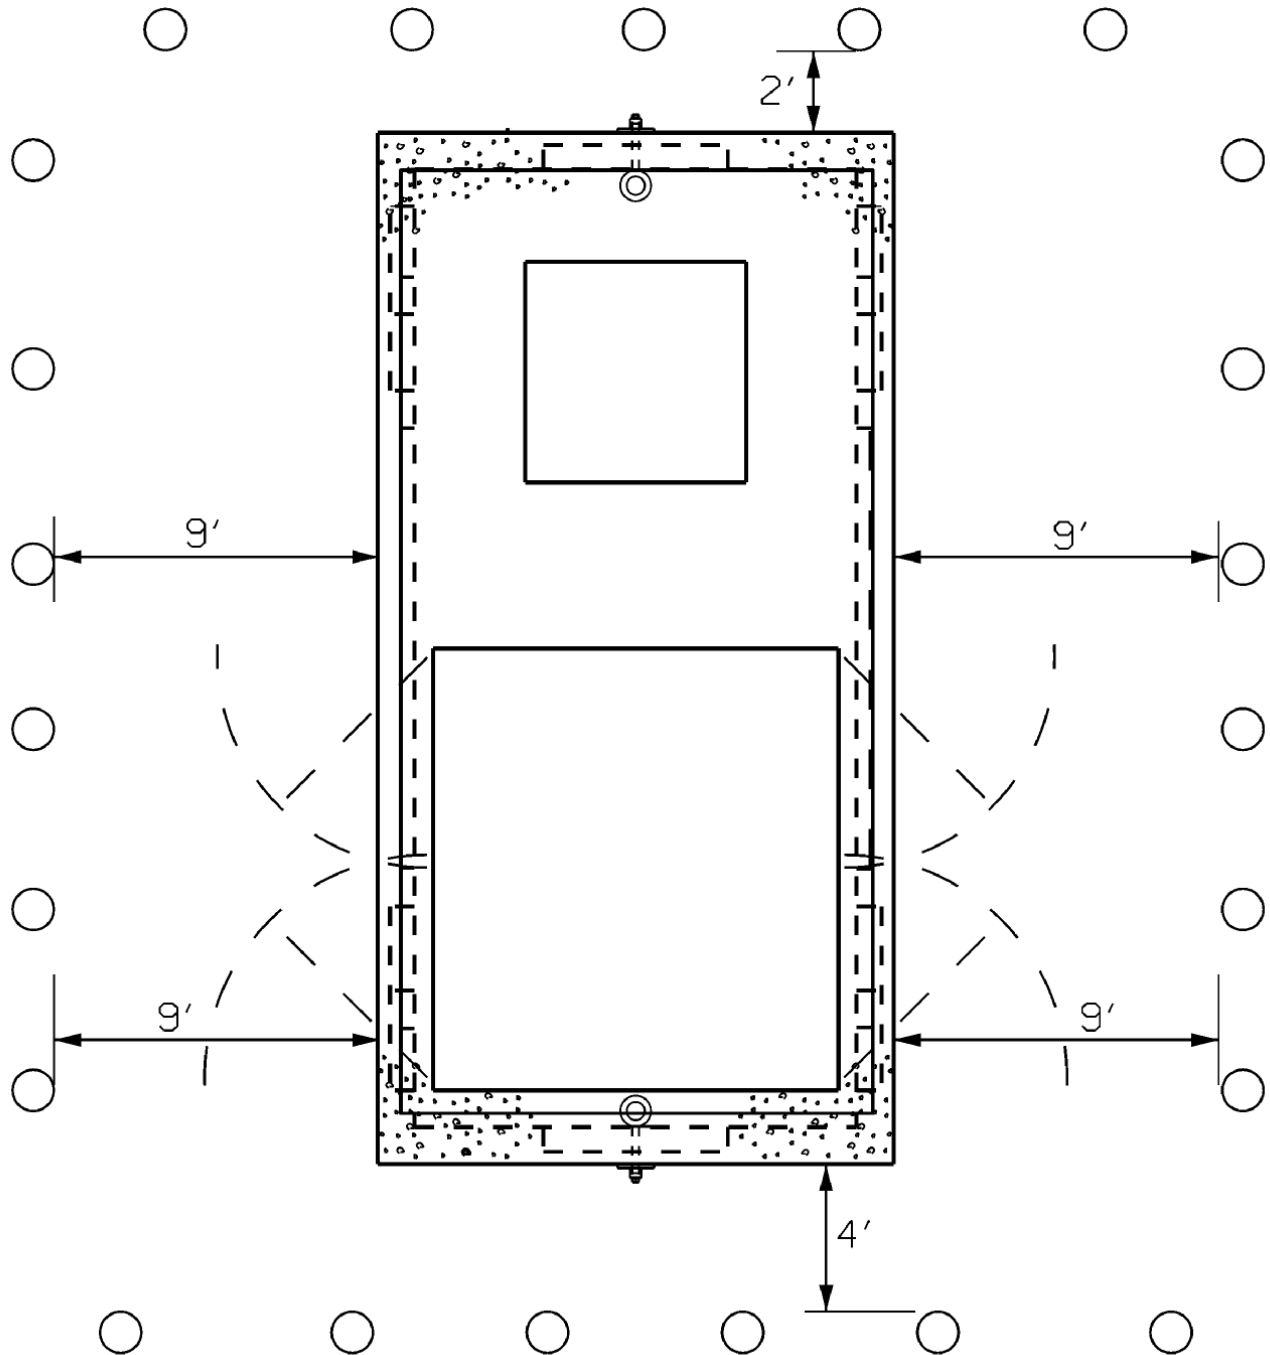

26.0 Fiberglass Switchgear Base with Conduit Entry's



The fiberglass switchgear base can be used as an alternate to the switchgear manhole in locations where allowed by the *company*. It is not recommended for installations where the primary coming into the base is 500MCM or larger.

NOTE: This base will only accommodate standard PMH-9, PMH 10, PMH 11 and PMH 12 switchgears.

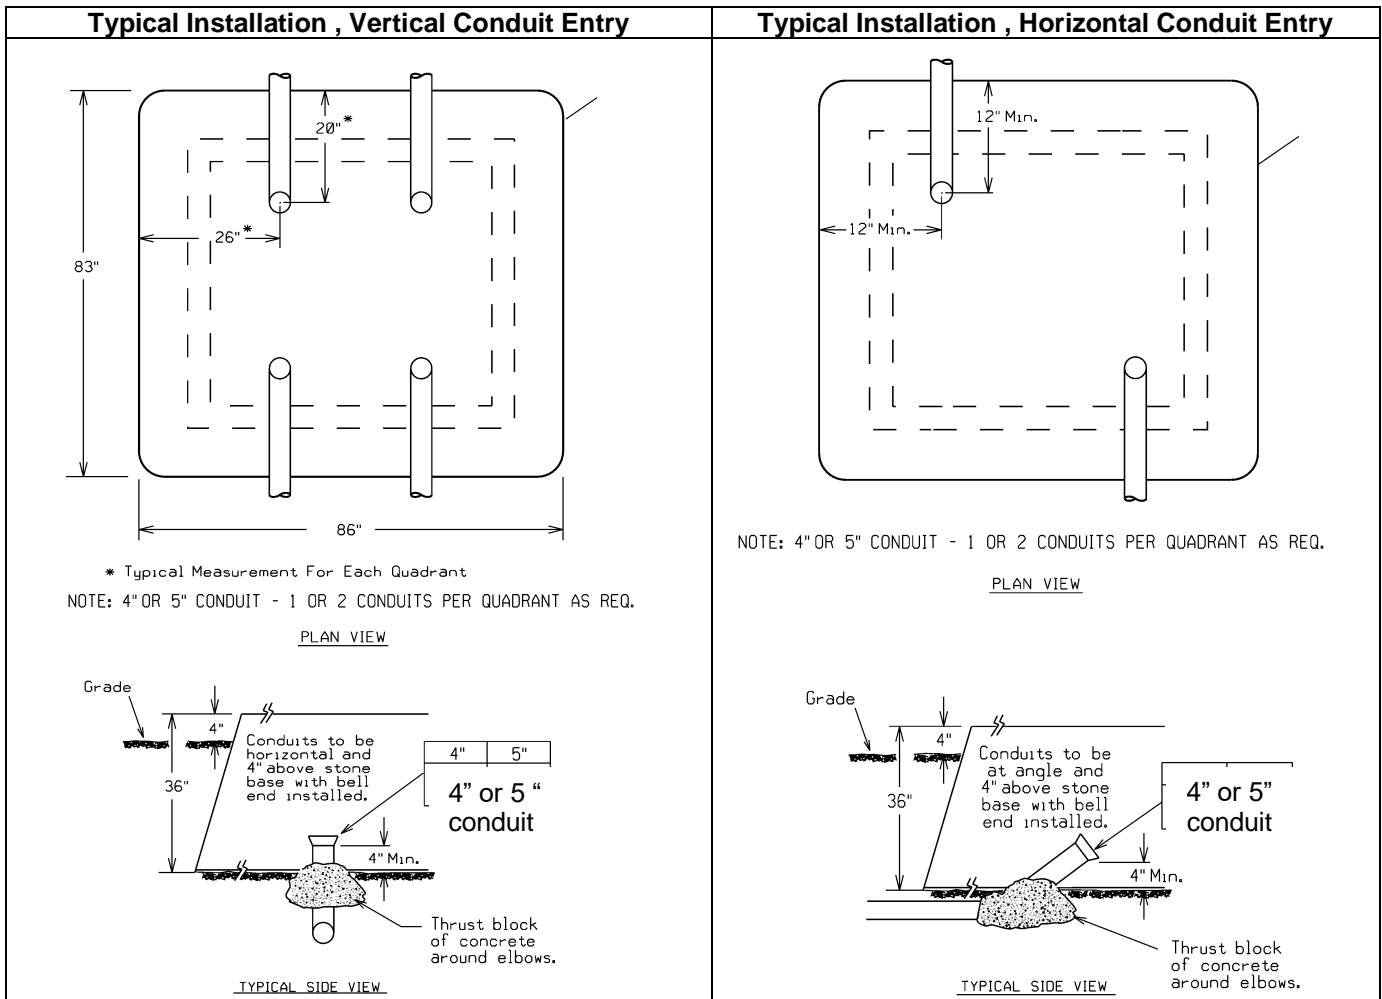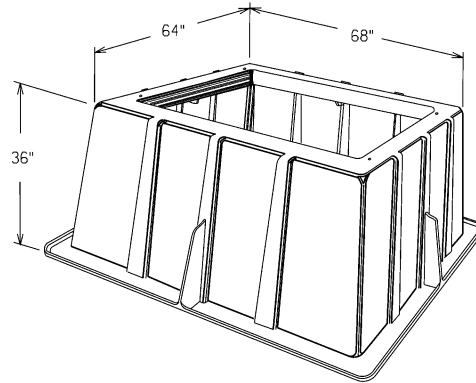

26.1 Fiberglass Switchgear Ground Grid

The Customer shall install the ground grid for a fiberglass switchgear installation as shown in the picture.

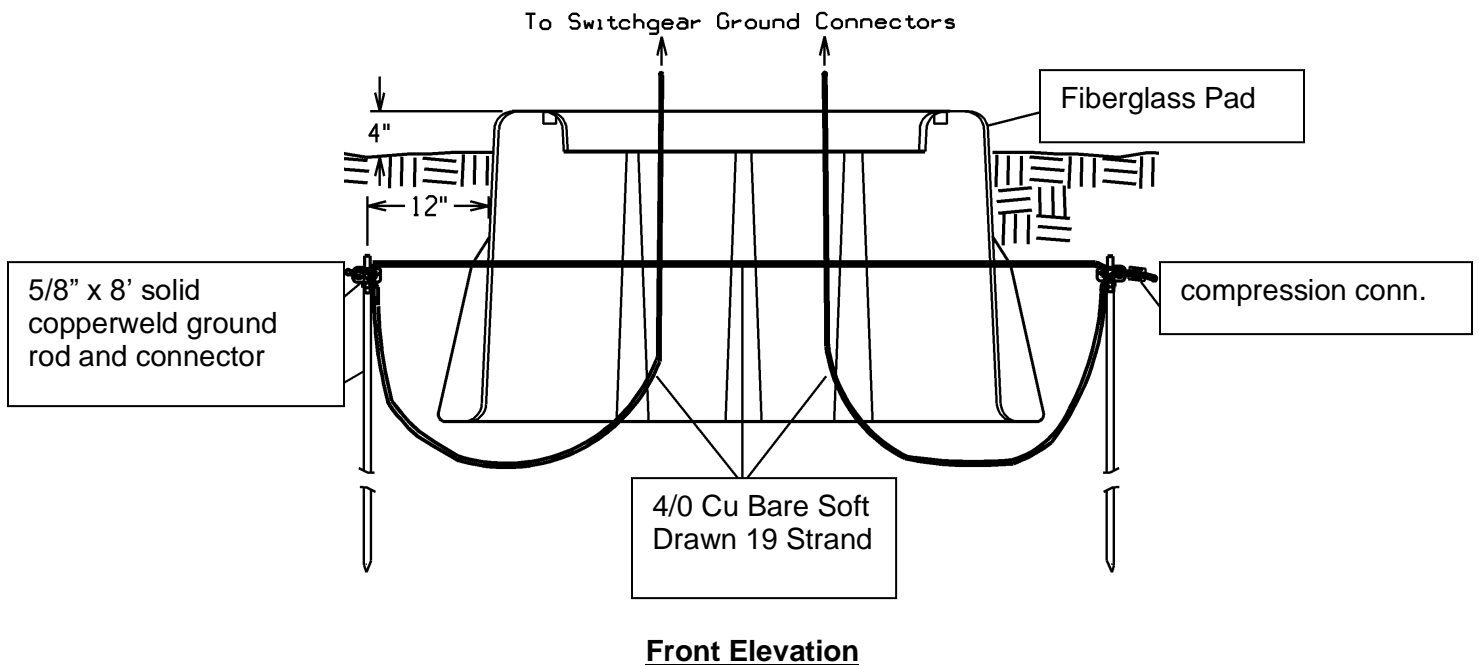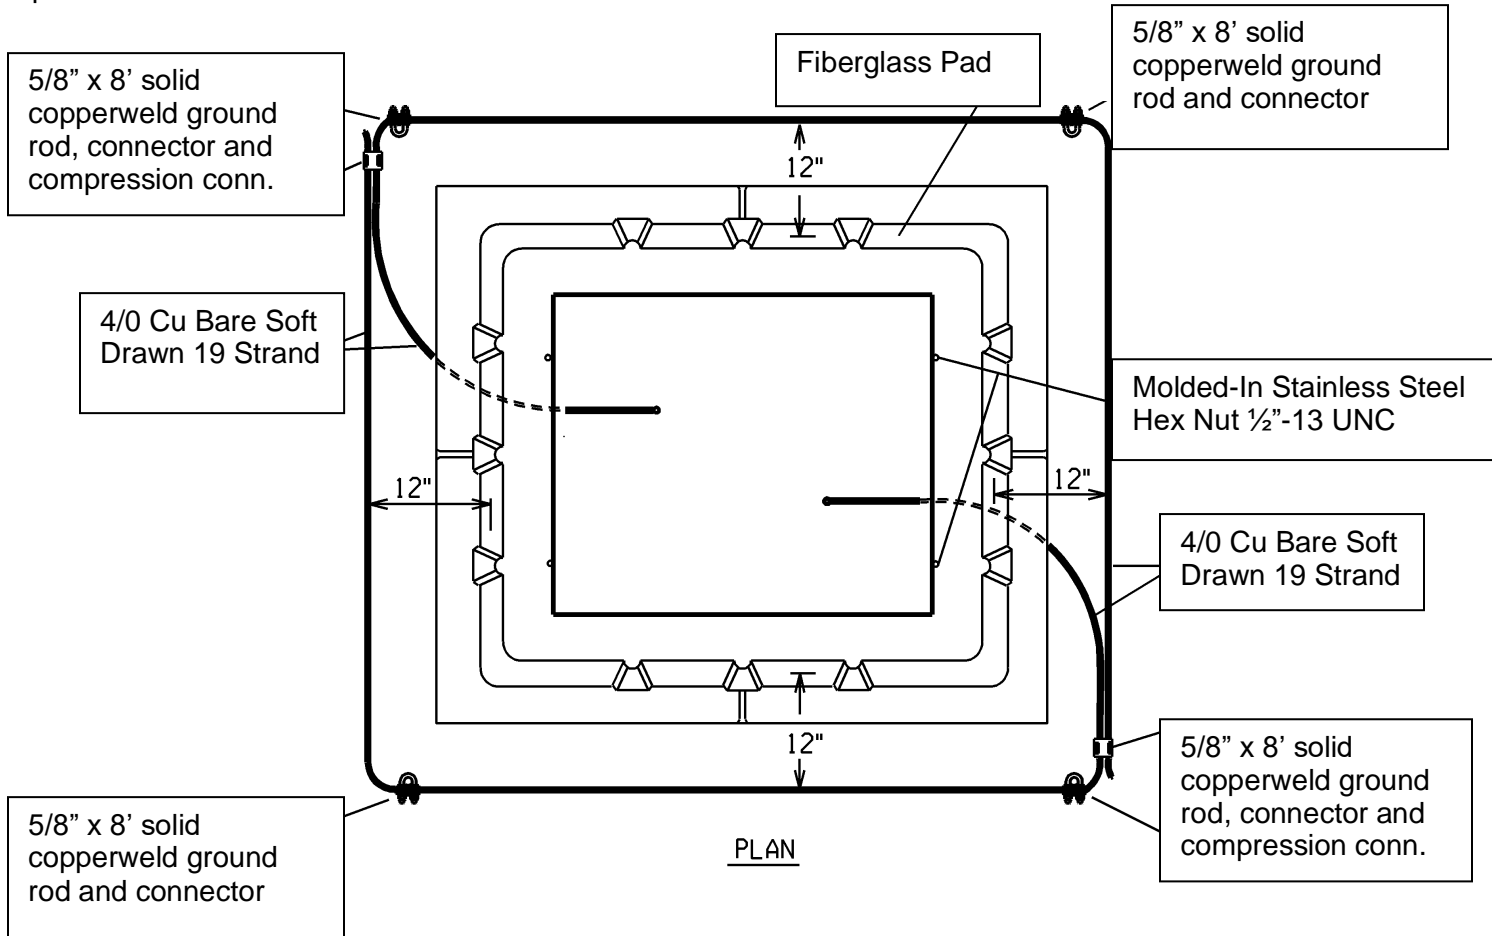

26.2 Switchgear Fiberglass Boxpad Bollard Layout

The drawing below depicts the locations for bollard installations around a switchgear fiberglass boxpad. Bold outline referenced on drawing is the exposed outside sides of the boxpad. Distribution Design/Planning and or company inspector shall designate the number and location of required bollards for each job. Refer to Transformer Mechanical Protection/Bollards in Section 11 for more details on bollards. Bold outline referenced on drawing below is the exposed outside sides of the boxpad.



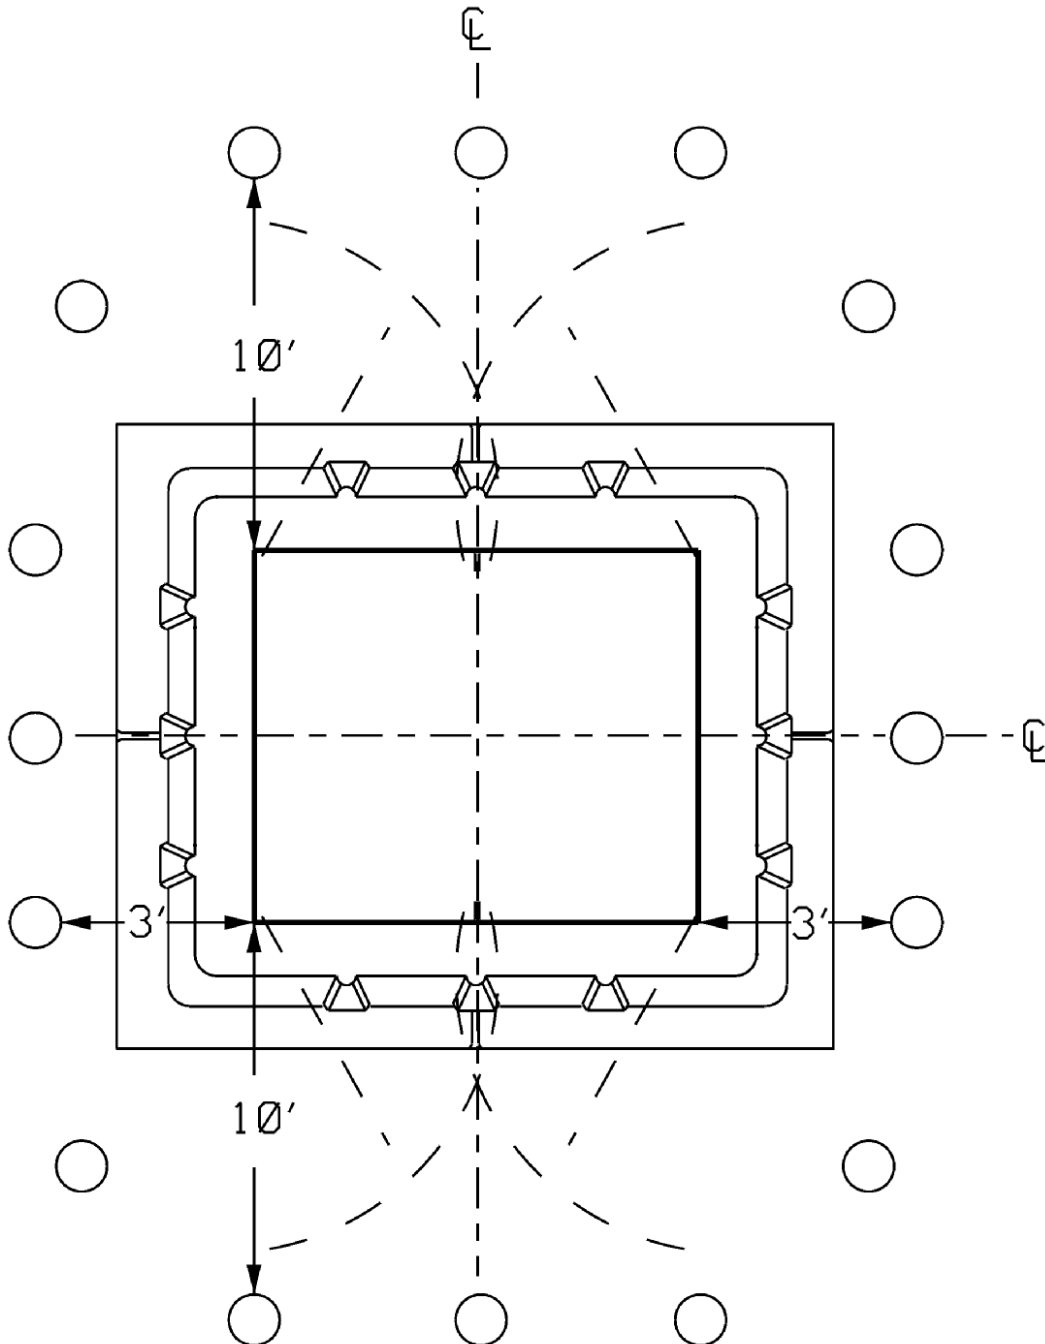



Figure 27.0-1 15kV Transformer Pad 75- 500kVA 44-113 (ref-44-113/UF8A)

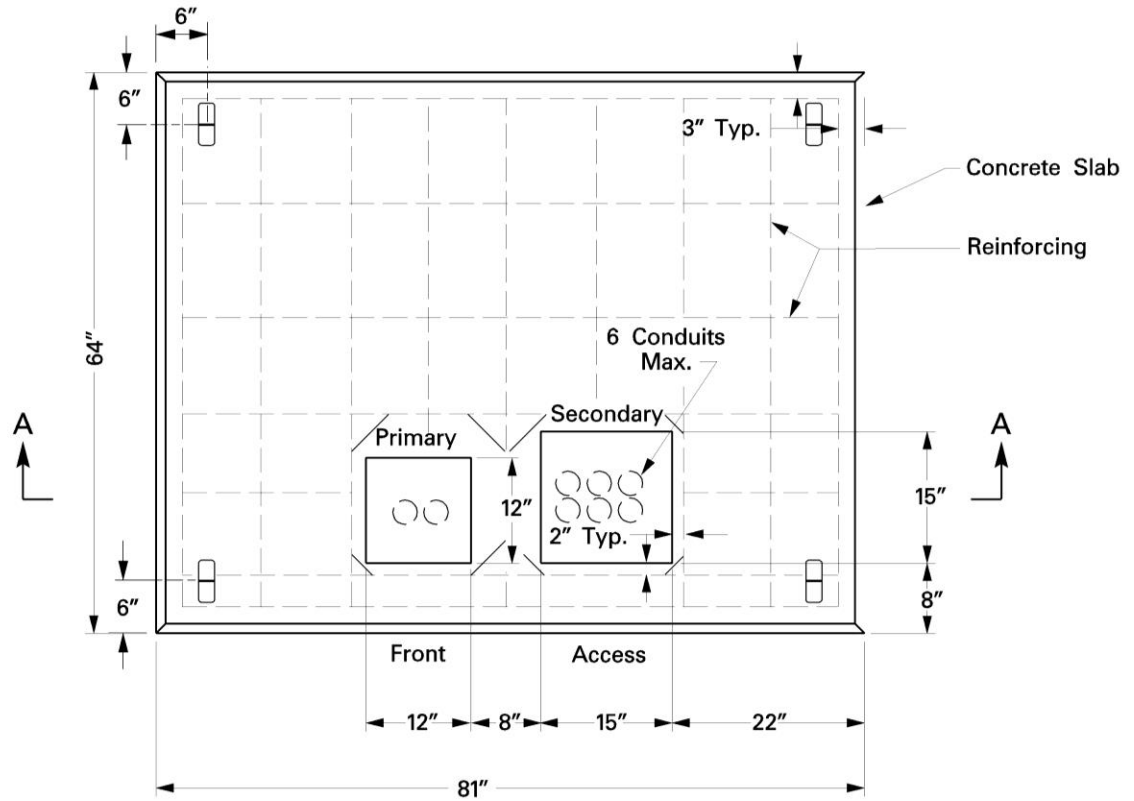

PLAN

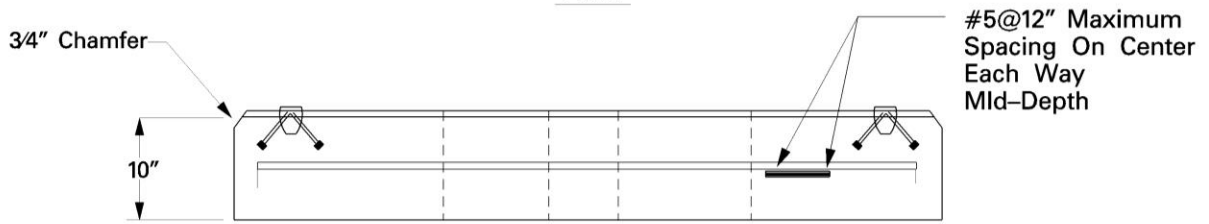

REBAR DIAGM

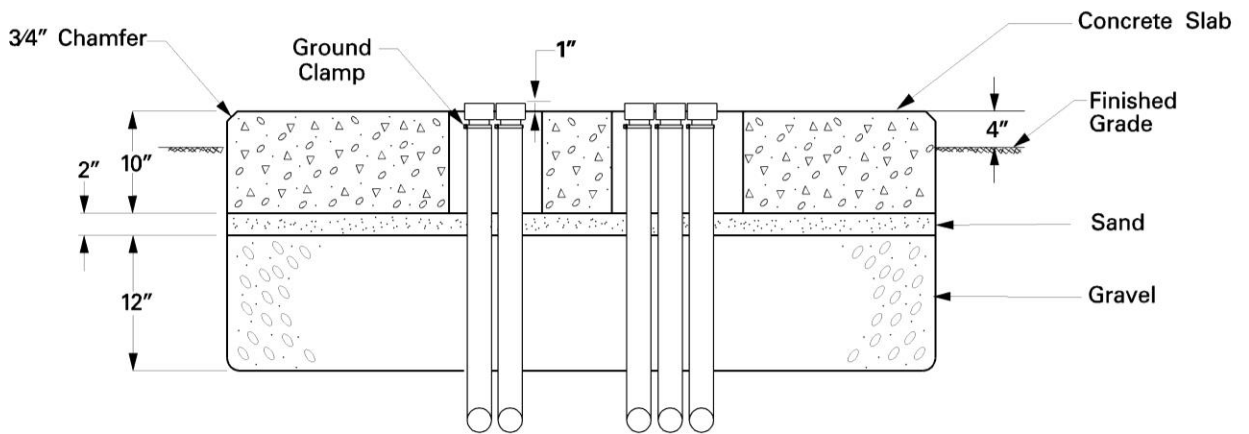

SECTION A-A

Figure 27.0-2 15kV Transformer Pad 750- 2500kVA 44-114 (ref-44-114/UF8B)

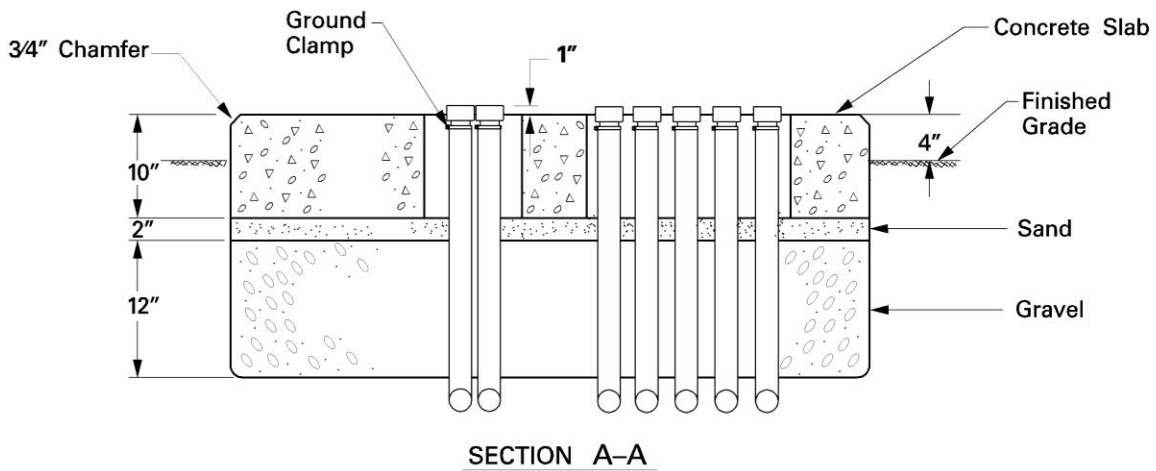
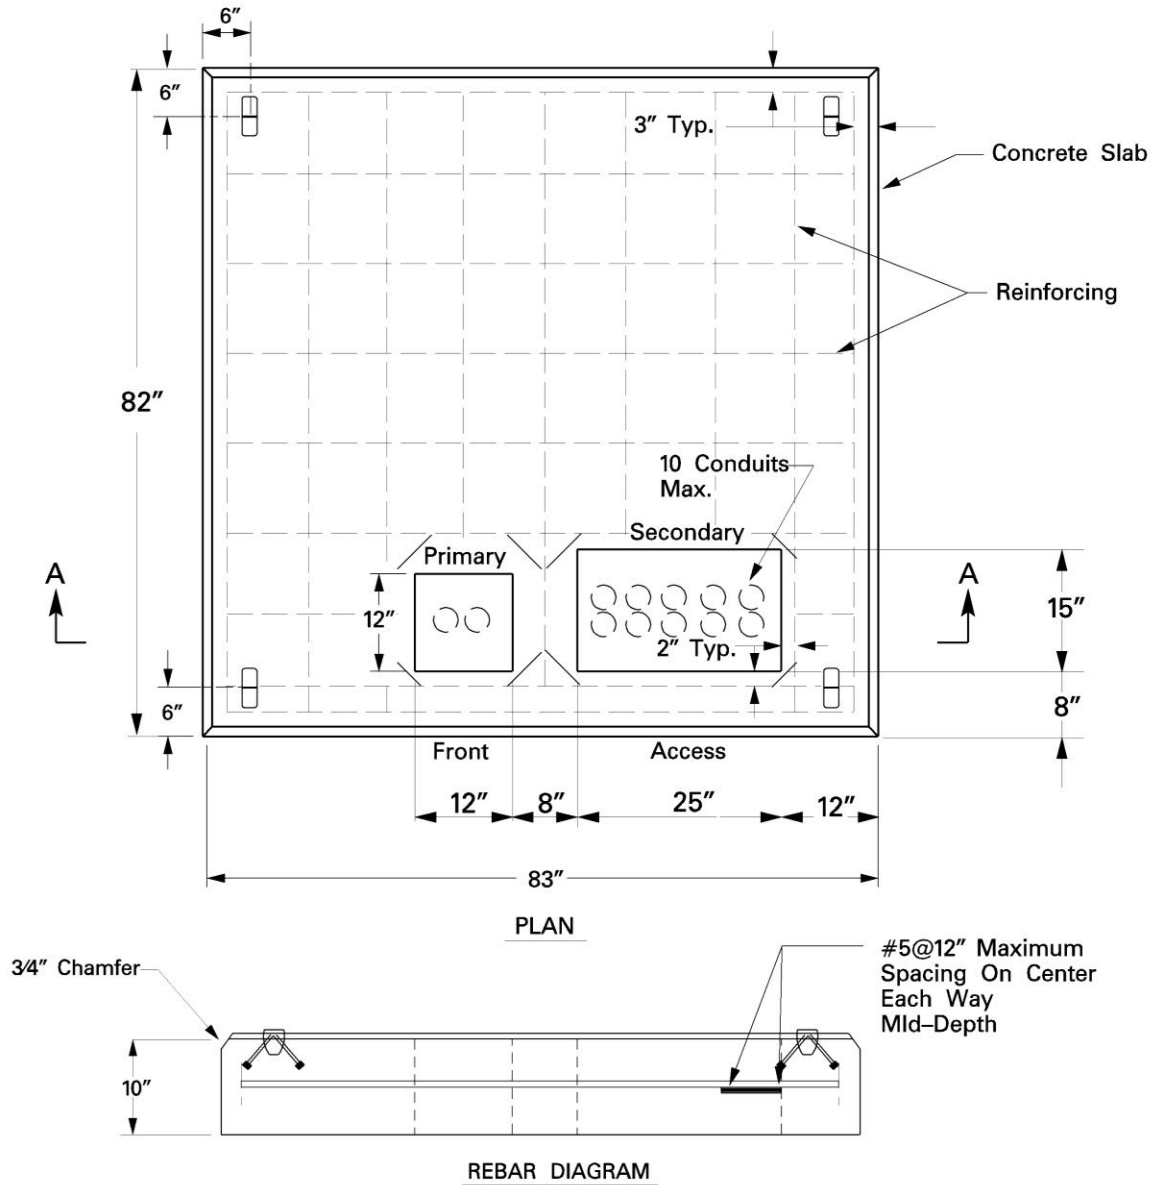


Figure 27.0-3 25-35kV Transformer Pad 75- 300kVA 44-115 (ref-44-115/UF8C)





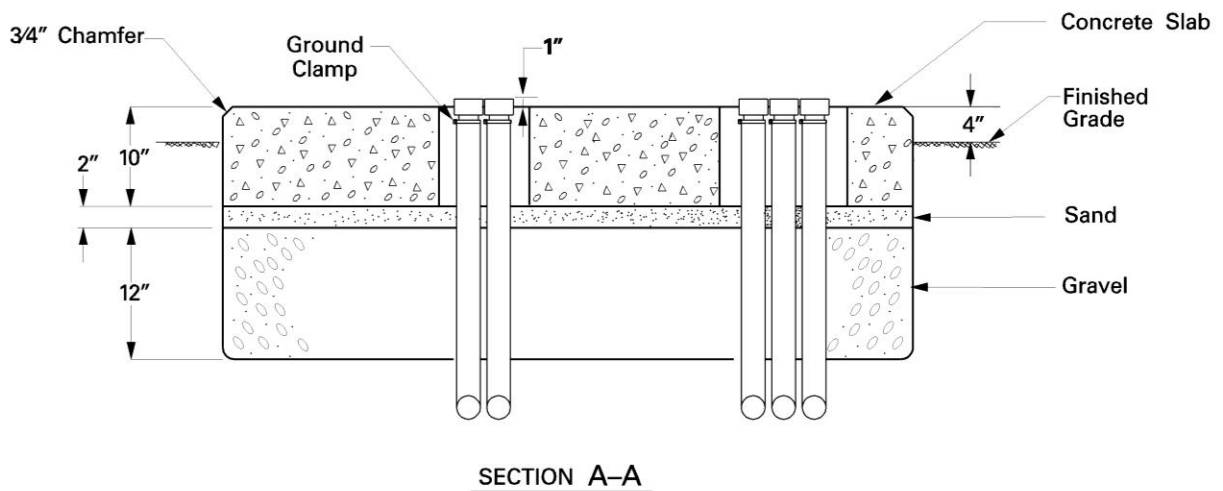



Figure 27.0-4 25-35kV Transformer Pad 500- 2500kVA 44-116 (ref-44-116/UF8D)

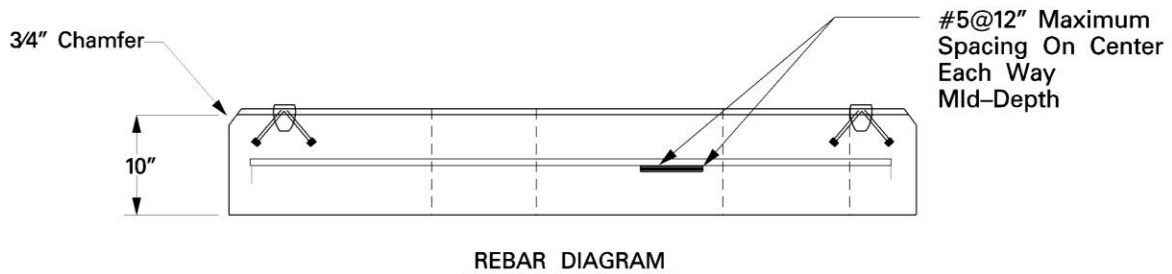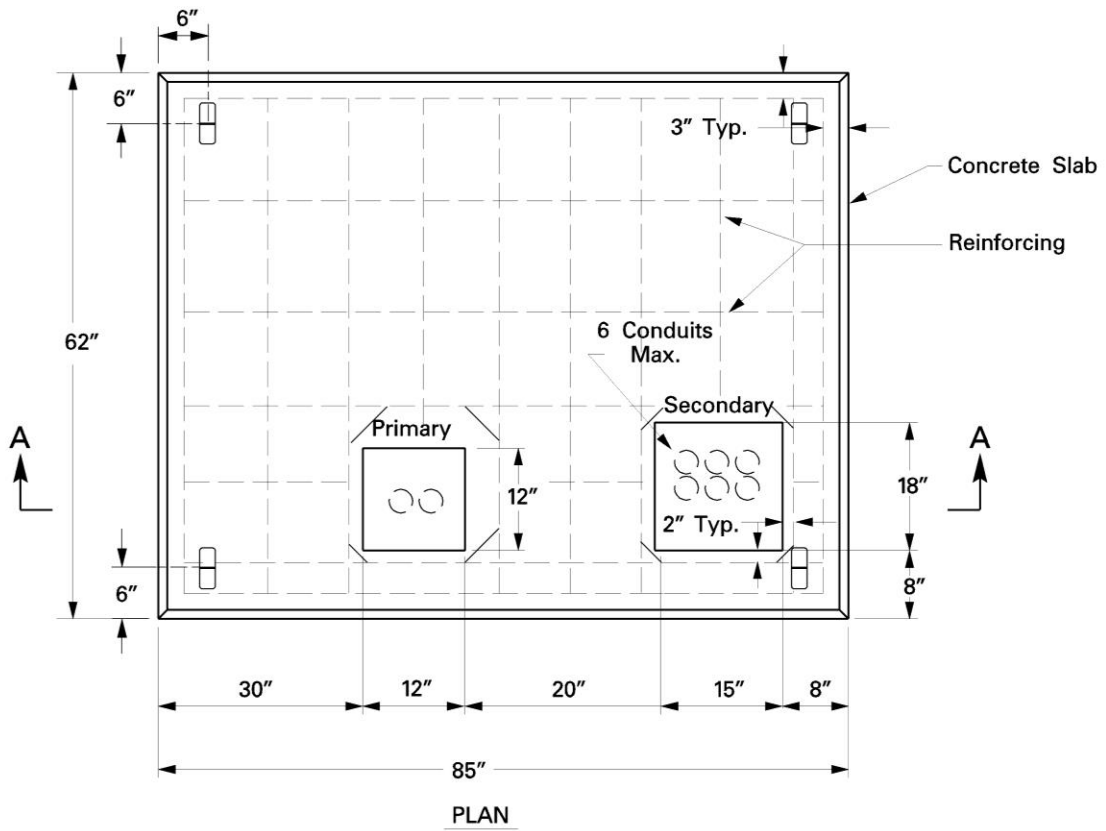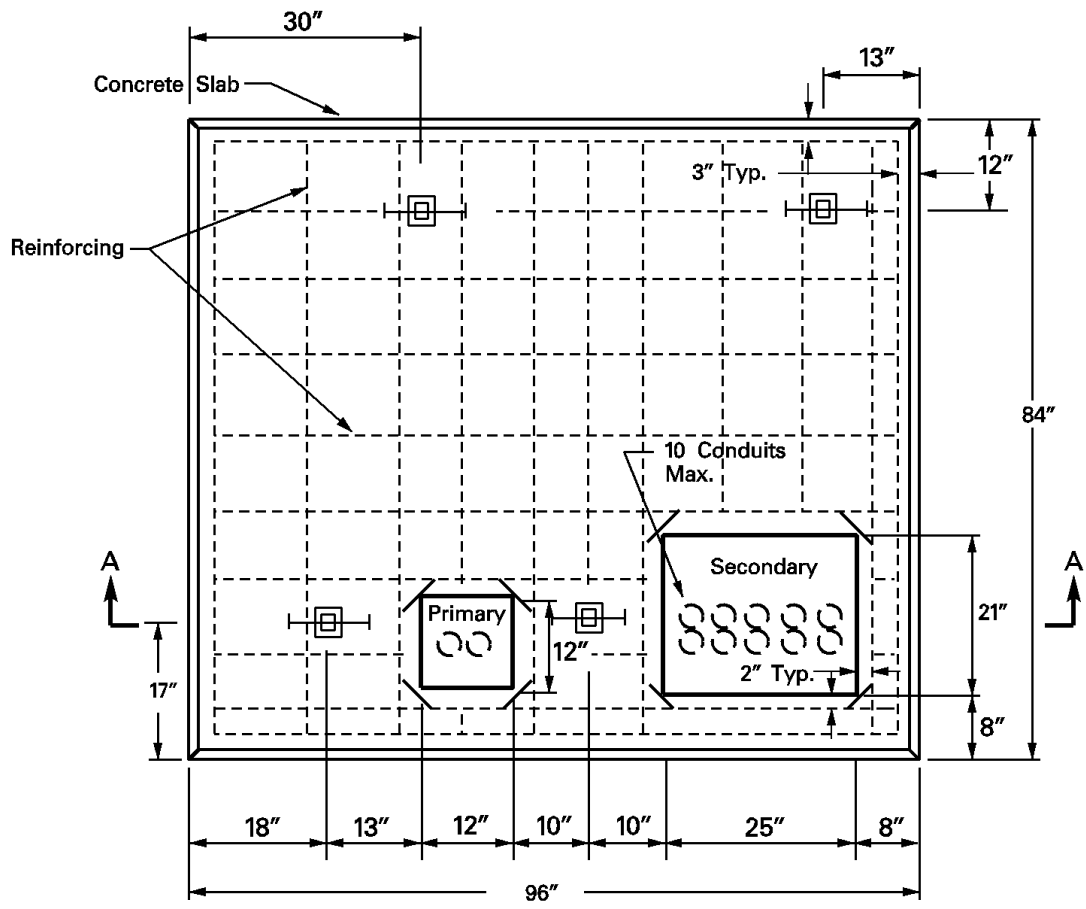

PLAN

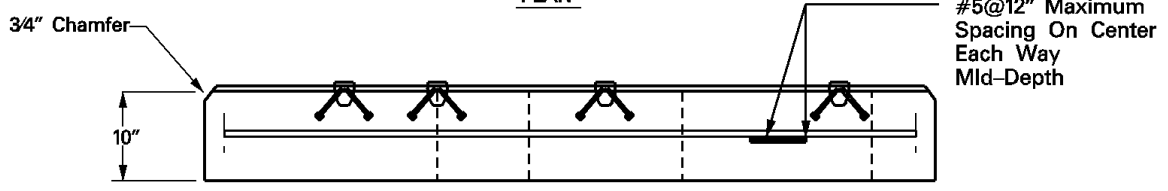

REBAR DIAGM

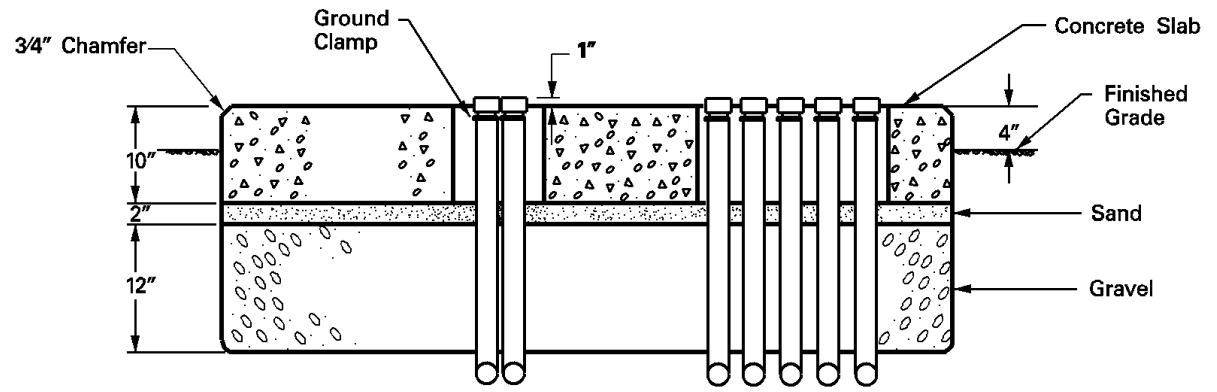

SECTION A-A

28.0 Sample Installations

Picture of Conduit Installation Before Concrete Pour



Picture of Ballard Installation




Picture of a Riser Pole Installation



Riser Pole Bonding


Rigid Galvanized Steel. Bond higher than 8' and at least 6" from top.

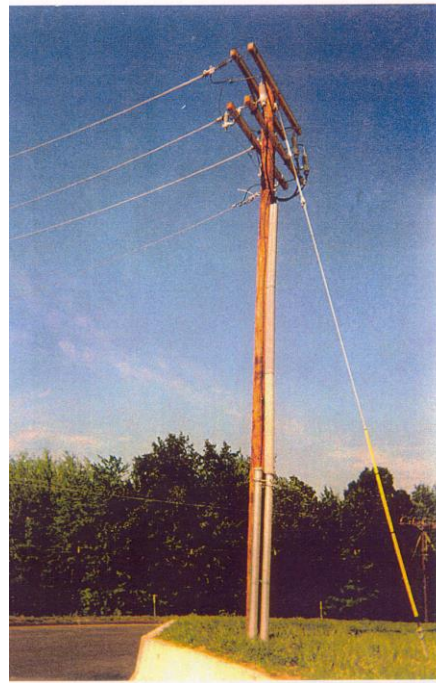


Completed Riser Pole

The Company will specify on which quarter of the pole the riser shall be installed, away from traffic.

Heavy Duty Handhole Installation

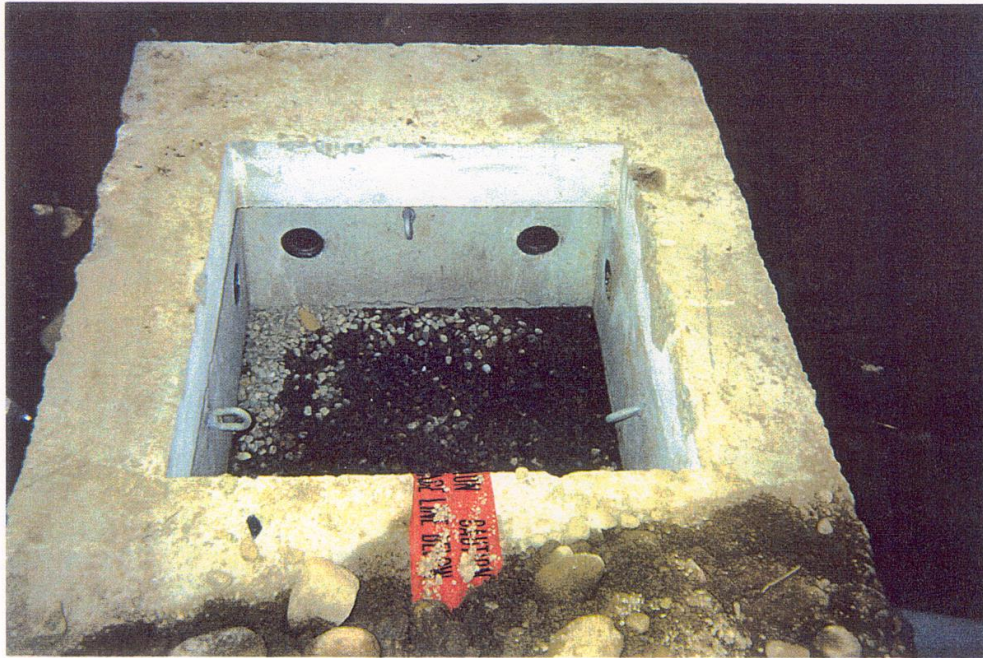

29.0 Bollard Detail

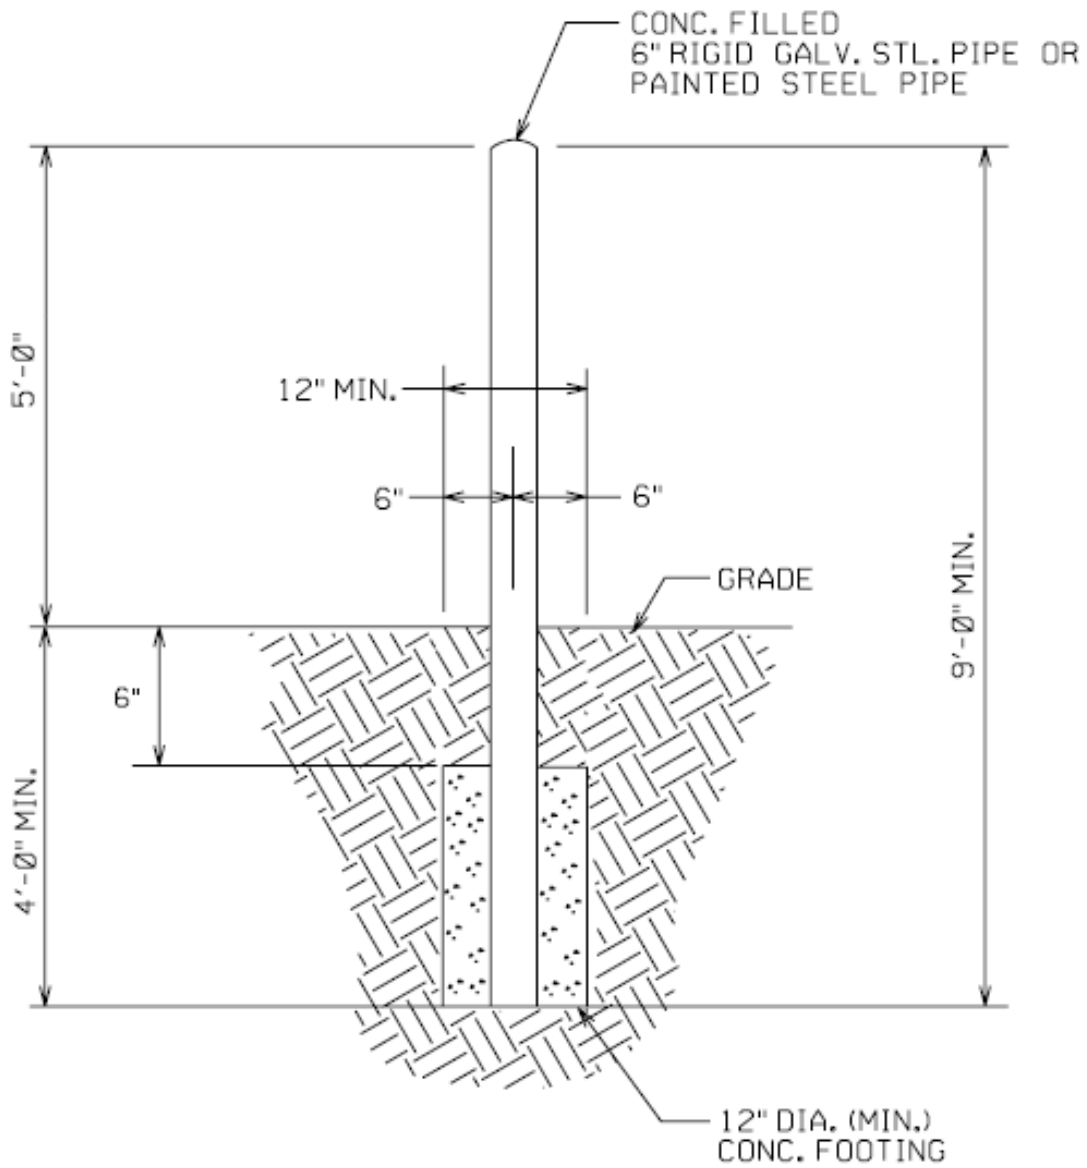

TYPICAL
BOLLARD DETAIL

30.0 Concrete Specifications

31.50 SCOPE - For general use of reinforced and plain concrete when job specifications are not being issued. Not for use when placing concrete underwater (Tremie concrete).

31.51 MATERIALS - Cement shall be a standard brand of Portland Cement Type II conforming to ASTM C150. If concrete is to be in contact with sea water or soils other than clean gravel, or if job conditions require earlier strength development than Type II provides, notify Civil Engineering for use of a higher strength or high-early strength concrete.

Sand shall be sharp and clean and shall conform to ASTM C33, latest revision.

Coarse aggregate shall be of gravel, crushed gravel or crushed stone and conform to ASTM C33, latest revision.

Water shall be from a potable water supply or tested and approved by Civil Engineering, assuring it is clean and free from injurious amounts of oil, acids, alkali, organic materials, or other harmful substances.

31.52. READY-MIX CONCRETE - Ready-mix concrete shall be proportioned at the plant. Mixing and delivery shall be in accordance with ASTM C94, latest revision. Mixes shall conform to Table 1 for minimum 28 day strength, nominal maximum size aggregate, and slump.

An air-entraining agent shall be added to concrete mixes in which the surface will be exposed to the elements. No other admixtures shall be used without approval of Civil Engineering. Air-entrainment content shall be as follows:

| | | | |
|----------------|-------------------------|----------------|-------------------------|
| Mix M2 and M3: | 7.0% plus or minus 2.0% | Mix M5: | 4.5% plus or minus 1.5% |
| Mix M4: | 5.0% plus or minus 1.5% | Mix M6 and M7: | 6.0% plus or minus 1.0% |

The Purchaser reserves the right to make tests at any time on materials used and concrete furnished by the ready-mix concrete supplier. The batch plant, equipment, and operating procedures are subject to inspection and approval by Civil Engineering or their qualified representative.

TABLE I - CONCRETE MIXES

| Mix Number | Strength Minimum 28 Day Lbs/Square Inch | Aggregate Maximum Size Nominal | Slump Not More Than | Typical Uses |
|------------|---|--------------------------------------|---------------------------|---|
| M1 | 2,000 | 1-1/2" | 2" | Bedrock and Floor Fill |
| M2 | 2,000 | 1/2" | 2" | Duct Lines - Tier Method |
| M3 | 2,000 | 1/2" | 6" | Duct Lines - Unit Method |
| M4 | 3,000 | 1-1/2" | 2" | Footings, Slabs on Ground, Foundation Walls, and Pile Caps |
| M5 | 3,000 | 1" | 2" | Floor and Roof Slabs on Forms |
| M6 | 4,000 | 1" | 2" | Hi-Strength Slabs and Walls |
| M7 | 5,000 | 1" | 2" | Hi-Strength Slabs and Walls |

NOTE: If a greater slump is required, contact Civil Engineering for an additive to meet the specific job requirements.

Ready-mix concrete shall be ordered in accordance with this Specification with a copy of same supplied to the ready-mix concrete manufacturer. The cubic yards, delivery point, time schedule, and applicable mix number for the particular application shall be specified on the order.

Delivery of a concrete batch in excess of the rated mixer drum capacity is cause for rejection. The latest drum inspection certificate should be available for verification.

- 31.53 CONCRETE - DELIVERY AND MIXING** - In the event that delivery of concrete is called for when the air temperature is below 40° F the following shall apply:
- a. When the air temperature is between 30° F and 40° F, the concrete shall be delivered in excess of 55° F.
 - b. When the air temperature is between 0° F and 30° F the concrete shall be delivered at a temperature in excess of 60° F.

In hot weather concrete shall be delivered at a temperature which will not cause difficulty from loss of slump, flash set, or cold joints. Discharge of concrete at the job site shall be completed within one (1) hour of adding the mixing water.

- 31.54 CONCRETE - FORMS** - Formwork shall be designed and constructed in accordance with the American Concrete Institute's "Recommended Practice For Concrete Formwork", ACI 347, of latest date.

Forms shall be built substantially; true to form, lines, dimensions, and grades shown. They shall be braced and tied to maintain position and shape, without yielding to pressure of fluid concrete or other forces, including those produced by vibratory compaction.

Forms shall be constructed of 3/4" BB grade plywood supported with 2 x 4 studs on 16" centers. Forms shall not exceed a 10' pour height and form tie spacing shall not exceed 2'. Form ties and accessories, manufactured by Richmond Screw Anchor Company or equal, shall be used. Prefabricated forms are allowed after approval by Civil Engineering. The forms shall be vertical and symmetrical and in the largest sizes practicable. Sheets showing torn grain, worn edges, hole patches, or other defects, which impairs the texture of the concrete surface, shall not be used.

Forms shall be treated with approved form oil, before erection or reinforcing steel placement, to prevent adhesion of the concrete.

Forms shall be mortar-tight. For surfaces which will be exposed, the form faces shall be smooth and mortar-tight.

Forms shall be removed carefully to avoid damage to the concrete surfaces. The removal time is governed by the concrete's condition, curing temperature, curing time, and the forces the new concrete may be subjected. Under favorable curing conditions, forms may be removed no sooner after placement than the following:

- seven (7) days for supported floor and roof slabs
- 48 hours for wall and columns
- 24 hours for footing walls and piers
- 12 hours for underground duct lines

If high-early strength concrete is used, the above time periods may be reduced by one-half.

These periods presented are the cumulative number of days or fractions thereof, not necessarily consecutive, during which the concrete temperature is above 50° F. Whenever formwork is removed during the curing period, the exposed concrete shall be repaired immediately, finished, and cured as specified under "Concrete - Curing".

31.55 CONCRETE - PLACEMENT - Concrete shall not be placed until the forms, previously poured concrete surfaces, reinforced steel, and embedded parts have been cleaned of laitance, loose or defective concrete, soil on rock surface, and any other foreign materials.

All concrete placed when the air temperature is above 45° F shall be placed at the coolest temperature as practicable. Concrete placement is not permitted when hot weather conditions prevent proper placement and consolidation. Concrete will not be accepted if its temperature is in excess of 80° F.

When the mean daily temperature falls below 40° F, the minimum concrete temperature shall be 55° F and as close to this minimum as possible.

When the air temperature is below 40° F, provide suitable protection so the concrete can be maintained at a minimum of 50° F throughout the curing period. The protection and heat source, shall maintain the required temperature and moisture conditions without injury due to concentration of heat. All materials which the concrete contacts such as reinforcing, forms, ground, etc., shall be free of frost prior to placement.

Concrete temperature changes during and immediately following the curing period shall be as uniform as possible and shall not exceed 5° F in any one hour, nor 40° F in any 24 hour period. When heaters are used, prevent local surface heating and drying and provide adequate ventilation to prevent carbonation damage to exposed concrete surfaces. Thermostatic temperature controls shall be provided to control the heated enclosures to 50° F. Temperatures exceeding 80° F are to be avoided.

Concrete shall not be allowed to fall from the end of a chute, tube, or bucket more than 5 feet to point of deposit and shall have a fall free from obstructions. Chutes shall be metal or metal-lined.

Pumping equipment, pipelines, procedures, etc., shall be in accordance with ACI 304R, latest revision, and Civil Engineering shall be consulted for mix design of any pumped application. Conveying equipment for pumped concrete shall be of suitable kind, without "Y" sections and with adequate pumping capacity. No aluminum pipe shall be used. Placement shall be controlled so there is no separation in the discharged concrete. The maximum loss of slump in pumping equipment shall be 1½".

Concrete shall be deposited as near to its final position as possible to avoid long flows in the forms. Concrete shall not be moved more than 10' from point of deposit. Concrete shall be placed in successive horizontal layers, ranging in thickness from 6" to 15" maximum. Concrete shall be placed within 1½ hours after addition of cement to the aggregate.

Where conditions make it difficult to place concrete uniformly and perform compaction at the bottom of forms, batches of mortar containing the same proportion of cement to sand as in the concrete mix shall be deposited first and spread over the cleaned surface to a depth of approximately 1".

Segregated, unworkable, and excessive slump concrete shall not be placed or, if placed, shall be removed and wasted as directed. High slump concrete resulting from addition of approved

additives is acceptable for placement. Free water accumulating on new concrete during placement shall be removed as directed by the Engineer.

Placement and compaction methods shall ensure homogeneous concrete with maximum consolidation without segregation. Consolidate concrete by internal vibration, spading, or rodding by working it thoroughly around reinforcement, embedded items, and into corners of forms to eliminate all air or stone pockets which cause honeycombing, pitting, or planes of weakness. Concrete contacting all formed surfaces shall be spaded manually to eliminate air bubbles.

Place horizontal construction joints at uniform vertical spacing unless otherwise shown on the drawings. Concrete shall not be placed to a depth of more than 10 feet in any 24 hour period, unless approved by Civil Engineering. All concrete placements shall be such as to keep cold joints from forming.

Whenever work is suspended on any section for more than one hour, the horizontal edges of the concrete next to the forms shall be brought to a plane perpendicular to the form face, and treated so no irregular, rough, or feathered edge joints show in the finished work. Before placing the next lift, clean the joint surface and remove all laitance. Immediately before placing new concrete wet the joint surface and remove all standing water.

Unless adequate weather protection is provided, do not place concrete during rain, sleet, or snow.

31.56 CONCRETE - CURING - Protect freshly deposited concrete from premature drying and hot or cold temperatures. Maintain a constant temperature throughout the curing period without drying.

All exposed concrete surfaces shall be kept continuously moist overnight by ponding, sprinkling, or by use of an approved membrane type curing compound, which conforms to ASTM C309, latest revision, and applied in conformance with the manufacturer's recommendations.

Curing shall continue, using one of the above methods or waterproof paper, for a 7 day period (3 days for high-early strength concrete) maintaining the concrete at a minimum temperature of 50° F as is practicable. Protective covering with tarpaulins, hay, straw, etc. shall be provided to retard moisture evaporation during hot weather and to prevent rain damage before hardening. Protective covering shall be available for immediate use at all times.

During the curing period, the concrete shall be protected from damaging mechanical disturbances, particularly load stresses, heavy shock, and excessive vibration.

31.57 SURFACE FINISH - All surface fins shall be removed.

Exposed concrete surfaces shall not be given any special treatment to enhance appearance, such as rubbing with a stone, without permission of Civil Engineering.

31.58 LOADING OF CONCRETE - Normal concrete structures shall not be subjected to external loads in less than:

- four days for foundations, manhole floors, and walls
- seven days for floors, roofs, and columns

Each concrete placement shall be allowed to set 48 hours before addition of a subsequent pour upon it. If high-early cement is used this time period may be reduced by one-half.

Trenches containing concrete encased duct lines constructed on undisturbed original ground may be backfilled not less than two (2) hours after placement. Compaction by light tamping

equipment may proceed immediately. Loading of the backfill by heavy equipment or traffic is not permitted before 12 hours after placement.

31.59 WATERPROOFING - Waterproofing is provided by the density of the concrete mix and the thickness of concrete. Care must be used in placing and compacting the concrete to eliminate all voids and potential leakage paths. When structures less than 8" thick must be waterproof, consult Civil Engineering to revise the mix design to achieve the desired waterproof result.



Rhode Island Energy™

a PPL company

RHODE ISLAND EASEMENT APPLICATION FORM

| FOR RIE'S USE ONLY | | | |
|---|---|---|---|
| Application for Easements (check one): | <input type="checkbox"/> OH (jointly owned or solely owned) <input type="checkbox"/> Padmount transformer only | <input type="checkbox"/> UG <input type="checkbox"/> URD | <input type="checkbox"/> Electric <input type="checkbox"/> Gas |
| Work Request # _____ | Telephone Number: _____ | | |
| Utility Engineer's Name: _____ | | | |

Please complete **ALL** of the sections below so that we may prepare an easement for your signature. Do not leave any sections unanswered. If a section does not apply to you simply put "n/a" on that line. Incorrect or incomplete information will delay service installation.

Property Owner(s): _____

Property Owner Mailing Address

Property Address of Easement

(if different from mailing address)

Address: _____

Address: _____

City: _____

City: _____

State: _____

State & County _____

Zip _____

Zip _____

Customer Contact Person: _____

Daytime Phone(s): _____

Re: Subdivision Title: _____

1. Provide us with a **RECORDED** copy of the present owner's deed, Book _____, Page _____

a) If multiple deeds make up the whole parcel, please include all deeds.

b) If the Property Owner is a b1) CORPORATION, b2) TRUST, b3) PARTNERSHIP, or b4) LIMITED LIABILITY COMPANY, provide the following which is applicable:

b1) President's Name: _____
 See Footnote¹
 Below

and Treas.'s Name: _____

Or

Vice President: _____

and Asst. Treas.: _____

¹ If neither "Name Combinations" is available, the person(s) signing the easement must have a Corporate vote authorizing them to sign on behalf of the Corporation.

b2) Trust: No. Of Trustees: _____ Name(s): _____
 Name of Trust: _____

b3) Partnership: No. Of Partners: _____ Name(s): _____

b4) LLC: Authorization to Sign, Name(s): _____

2. a) Provide us with an approved: "Definitive Subdivision Plan"
 Plan Book: _____, Plan: _____, Dated: _____

b) If there is no recorded subdivision plan please include the following information:
 Assessor's Map: _____ Block: _____, and Lot: _____

3. Is your property mortgaged (circle one)? YES NO If "YES", please complete this section:
 Name of Bank/Company/Person holding mortgage(s): _____
 a) _____
 b) Address of mortgage holder(s): _____
 Date and recording information of mortgage(s): _____
 c) _____
 Date: _____ County Recorded: _____ Book: _____ Page: _____

Additional Comments:

Please contact your Account Manager or Service Administrator if you have any questions regarding this form.

32.0 Concrete Approved Precast Manufacturers

| | |
|--|--|
| <p>Arrow Concrete Products 560 Salmon Brook St Granby, CT 06035 Jim Jurczyk 1-860-653-5063</p> | <p>D.A. Collins 101 Route 67 Mechanicville, NY 12118 Andrew Timmis 1-518-664-9855</p> |
| <p>Fort Miller Company P.O. Box 98 Schuylerville, NY 12871 Joe O'Malley 1-518-695-5000</p> | <p>Grimm - Green Island Green Island, NY 12183 1-518- 272-1100</p> |
| <p>Hoytes Concrete Products 7839 New Floyd Road Rome NY 13440 Thomas Hoytes 1-877-336-7789</p> | <p>Jefferson Concrete 22850 Murrock Circle Watertown NY 13601 1-315-788-4171</p> |
| <p>Kistner Concrete Products Inc. 5550 Hinman Rd Lockport, NY 14094 1-716- 434-6157</p> | <p>Lakelands Concrete 7520 E. Main St. Lima NY 14485 Carl Ashley 1-585-624-1990</p> |
| <p>Old Castle Precast 41 Almeida Rd Rehoboth MA 02769 Bruce Blackledge 1-508-336-7600</p> | <p>Shea Concrete 87 Haverhill Street Amesbury, MA 01913 Greg Stratus 1-800-696-7432</p> |
| <p>United Concrete 173 Church St. Yalesville CT 06492 Tom Long 1-203-535-4114</p> | <p>Utility Precast Inc. 153 Cranberry Highway Rochester MA 02770 1-508-291-1314</p> |
| | |

33.0 Approved Material – Underground Commercial Installations

| RIE Item ID | Item Description | Manufac #1 Part No. | Manufac #2 Part No. | Manufac #3 Part No. |
|----------------------------|--|------------------------------------|------------------------------|-----------------------|
| Conduit – Straight | | | | |
| 2010404 | Conduit, 4", PVC | Carlton: 48815 | IPEX: 8741 | Cantex A79EA42 |
| 2011024 | Conduit, Galvanized, 4" | By Description | | |
| Conduit – Bends | | | | |
| 5690446 | Bend, Galvanized, 4" 36" radius | BayneJones 400R9036 | Conditmfg TUB490D36RGALEL | |
| 5690493 | Bend, PVC Sch 40, 4", 90 Degree, 36" Rad. | Cantex: 5233842 | Carlton: UA9FNB | Certifsaft 59734 |
| Spacers | | | | |
| 5646963 | Spacer, 4", Base | GS Industries: 186-1 | IPEX: 29573 | |
| 5646960 | Spacer, 4", Inter. | GS Industries: 185-1 | IPEX: 29557 | |
| Conduit Accessories | | | | |
| 5641210 | Riser Strap, 4" | Electrical Materials: 50-4 USHD | BayneJones MINRLAC HD-296 | |
| 7011830 | Lag Screw, 1/4" x 2" | Elect. Materials 106 or 106M | Joslyn J26486.1 | PLH LSNW-142 |
| 3503074 | Pipe Grd. Connector, 4" and 5" | Burndy GAR3905-BU | Thomasbett (0)3905-BU | |
| 2010424 | Temporay Duct Plug, 4" DB | Carlton: P258NT | Scepter 57 | |
| 2011254 | Duct Plug Galvanized 4" | Crousehind PLG105 | | |
| 2010434 | Adapter, Female, PVC-Steel, 4" | Carlton: E942N | Cantex: 5140052 | Scepter FA55 |
| 5693359 | Coupling, 5 Degree, Bell-Spigot, 4" | Carlton: E244N | Cantex: 6151452 | Certifsaft 59544 |
| 2010444 | Coupling, 5 Degree, Bell-Bell, 4" | Ameripipe FT518 | Carlton E2440NF | Scepter 7604360040 |
| 2010454 | Straight Coupling, 4" | Carlton: E240N | Scepter 760443540 | |
| 2010464 | Bell End Female 4" | Carlton: E997N | Cantex: 5144012 | |
| 9202062 | Mule Tape | NEPTCO WP2500P | Arnco DLWP25 | Condux 08096303 |
| 2011254 | Plug Galvanized. 4" Threaded for Spare Riser | CROUSEHIND PLG105 | | |
| 9202201 | Plug Conduit 4" with metal loop for mule tape. | Carlton MAEPG7 | | |

| RIE Item ID | Item Description | Manufac #1 Part No. | Manufac #2 Part No. | Manufac #3 Part No. |
|---|--|--|------------------------|-----------------------|
| Transformer Foundations – Precast | | | | |
| 9200896 | Three Phase 15 kV 75-500 kVA | Reference 044-113 UF8A | Lakeland UF8A | |
| 9202324 | Three Phase 15 kV 750-2500 kVA | Reference 044-114 UF8B | Lakeland UF8B | |
| 9200898 | Three Phase 25-35kV 75-300kVA | Reference 044-115 UF8C | Lakeland UF8C | |
| 9200896 | Three Phase 25-35kV 500-2500kVA | Reference 044-116 UF8D | Lakeland UF8D | |
| Grounding Accessories | | | | |
| 2011100 | Grounding Bushing, 4" | CROUSEHIND GLL-10C | OZGEDNEY BLG 4122 | |
| 3503013 | Grounding Rod 5/8" x 8' Solid Copperweld | ERITECH 615880 | Galvin 6258 | Joslyn: J8338 |
| 9201272 | 2/0 Cu, Bare, Soft Drawn, 19 Strand | By Description | | |
| 3503328 | Ground Rod Clamp | Burndy: GRC58 | Blackburn: JAB58H | Electromotion EM58DBW |
| 5960412 | "C" Connector, 2/0 – 2/0 | Burndy: YC26C26TN | | |
| 3503074 | Clamp, ground, conduit 4" heavy duty, Bronze | Burndy GAR3905-BU | | |
| Splice box, Handhole, Switchgear Manhole | | | | |
| 5640808 | Splice Box as shown on | CDR Systems PA12-3060-37 | Highline CVA306038HEIK | |
| 5643075 | Heavy Duty Handhole on | Oldcastle Precast 502600 | | |
| 9200893 | Switchgear Manhole 15kV | Oldcastle Precast 202700/203400/203900 | | |
| 9200894 | Switchgear Manhole 25-35kV | Oldcastle Precast 202700/203400/204000 | | |
| 2012198 | Fiberglass Switchgear Base | HighLine HL-54 | | |
| Precast Oil Containment Wall | | | | |
| 9202153 | Three Phase 15 kV 75-500 kVA | Oldcastle 13411 | Lakeland TPC UF8A | Arrow S-OCC 134110 |
| 9202154 | Three Phase 15 kV 750-2500 kVA | Oldcastle 135134 | Lakeland TPC UF8B | Arrow S-OCC 135134 |
| | Three Phase 25-35kV 75-300kVA | Oldcastle 13411 | Lakeland TPC UF8C | |
| | Three Phase 25-35kV 500-2500kVA | | Lakeland TPC UF8D | |

| RIE Item ID | Item Description | Manufac #1 Part No. | Manufac #2 Part No. | Manufac #3 Part No. |
|--------------------------------------|---------------------|-----------------------------|---------------------|---------------------|
| Manhole Frame, Ring and Cover | | | | |
| 5644514 | Frame 36" square | Lebaron Foundry LE386 | Syracuse Casting | |
| 5644550 | Ring 26" to 36" | Lebaron Foundry LE2836X1 | Syracuse Casting | |
| 5644360 | Cover 26" | Lebaron Foundry L28C11 | Syracuse Casting | |

34.0 Other Materials/ Suppliers

Secondary connectors

Burndy Co

Richards Co

Utilco

Compression Connection Crimp Tool (used for ground grids)

Burndy MD7-8 with the extra die set (W-BG).

Stuart C. Irby Co
4583 Buckley Road
Liverpool, NY 13088
Peter Karl
1-315-652-1238

Secondary Splice box

Elliot Industries

A.B.B.

Manhole frame, ring and cover

Lebaron Foundry
1-800-626-4653

Syracuse Casting
1-315-699-2601

Bollard Covers

Part number # BC760YW

Innoplast 1-800-516-9287

The materials in this book can be found at most Electrical supply stores, listed below are a few.

Baynes Electrical Supply
1-800- 242-0911

Electrical Wholesalers
1-800-522-3232

Granite City Electric
1-800-850-9400

Graybar Electric
All service areas US
1-800-472-9227

Wesco
New Hampshire
1-800-258-5228

35.0 Job Check Off Sheets

35.1 3 PHASE, CONDUIT ENCASED IN CONCRETE INSPECTION CHECK LIST

Do not pour concrete or backfill BEFORE conduit system inspection and approval by company inspector. Every item listed below must be inspected and checked by a company inspector.

N* **Y***

PRE-TRENCH (no inspection)

- | | | |
|--------------------------|--------------------------|---|
| <input type="checkbox"/> | <input type="checkbox"/> | Final grade established, surface rough graded, and roadways staked. |
| <input type="checkbox"/> | <input type="checkbox"/> | Developer has Service Specifications on site. |
| <input type="checkbox"/> | <input type="checkbox"/> | Easement has been executed. |

TRENCH (prior to concrete encasement)

- | | | |
|--------------------------|--------------------------|--|
| <input type="checkbox"/> | <input type="checkbox"/> | Min. 30" depth from <u>existing grade</u> to top of encasement during all phases of construction. |
| <input type="checkbox"/> | <input type="checkbox"/> | Electric conduits on "road side", with 1 spare conduit, in all multi-utility trench installations. |
| <input type="checkbox"/> | <input type="checkbox"/> | Min. separation between electrical conduit and foreign conduits or pipes. |
| <input type="checkbox"/> | <input type="checkbox"/> | All road crossing perpendicular. |
| <input type="checkbox"/> | <input type="checkbox"/> | Conduit plugs installed. |
| <input type="checkbox"/> | <input type="checkbox"/> | Plastic spacers properly installed every 5 to 8' intervals' and at every coupling. |
| <input type="checkbox"/> | <input type="checkbox"/> | All curves properly formed with 5° couplings. |
| <input type="checkbox"/> | <input type="checkbox"/> | Company conduits to be in separate encasement from all other utilities. |

PRE-BACKFILL (after concrete encasement)

- | | | |
|--------------------------|--------------------------|--|
| <input type="checkbox"/> | <input type="checkbox"/> | Company conduit in separate encasement. |
| <input type="checkbox"/> | <input type="checkbox"/> | Minimum separation to foreign utilities and subsurface pipes maintained. |
| <input type="checkbox"/> | <input type="checkbox"/> | Encased concrete thickness > 3" around all conduits. |
| <input type="checkbox"/> | <input type="checkbox"/> | Sand or screened backfill (with less than 1" stones) on-site for backfilling entire trench, (inspector may witness backfilling). |
| <input type="checkbox"/> | <input type="checkbox"/> | Warning tape 8" to 12" below finish grade and directly above electrical conduit system. |
| <input type="checkbox"/> | <input type="checkbox"/> | No parallel non company utilities directly above or below electrical system. |

AFTER BACKFILL (pre-conductor installation inspection)

- | | | |
|--------------------------|--------------------------|---|
| <input type="checkbox"/> | <input type="checkbox"/> | Install 2500 lb. Pulling Tape in all conduit after rodding with a mandrell. |
|--------------------------|--------------------------|---|

HEAVY DUTY HANDHOLE

- | | | |
|--------------------------|--------------------------|--|
| <input type="checkbox"/> | <input type="checkbox"/> | 6" of crushed stone under handhole. |
| <input type="checkbox"/> | <input type="checkbox"/> | Seal around conduit entrances with concrete or mortar. |
| <input type="checkbox"/> | <input type="checkbox"/> | Manhole cover at finish grade with 2 courses of brick and grout for chimney. |

PULLBOX/SPLICE BOX

- | | | |
|--------------------------|--------------------------|---|
| <input type="checkbox"/> | <input type="checkbox"/> | 4" of crushed stone under pullbox foundation. |
| <input type="checkbox"/> | <input type="checkbox"/> | Cover left secured to box when unattended. |
| <input type="checkbox"/> | <input type="checkbox"/> | Flush with sidewalk or slightly above any grassy area. |
| <input type="checkbox"/> | <input type="checkbox"/> | Installed behind curb or other protection to prevent damage (e.g. snowplow) |

RISER POLE

- | | | |
|--------------------------|--------------------------|--|
| <input type="checkbox"/> | <input type="checkbox"/> | 90° BEND AND straight pipe galvanized steel conduit. |
| <input type="checkbox"/> | <input type="checkbox"/> | Steel-PVC adapter and steel sweep shall <u>not</u> be encased. |
| <input type="checkbox"/> | <input type="checkbox"/> | Ground clamp installed with tap. |

*NOTE Y – Acceptable N – Deficient

35.2 TRANSFORMER FOUNDATION INSPECTION CHECK LIST

Do not pour concrete prior to inspection and approval by Company of the pad forming and reinforcement, the subgrade preparation, and the ground grid. Do not back fill after removing the forms prior to pad inspection. Every item listed below must be inspected and checked off by Company inspector.

N* Y*

PRE-INSTALLATION

- Proposed location within 10' of paved way open to vehicular access.*
- Proposed location has minimum of 10' clear space in front of transformer doors.*
- Proposed location has minimum clearance to buildings, doorways, windows, ventilation ducts, fire escapes, and other combustibles*
- Bollard locations are identified by Company.*
- Ground grid installation and two ground rods*

PRE-POURING

- 12" gravel and 2" sand below pad location..*
- Reinforcing bars.*
- Concrete forms correct height, size, orientation, opening, etc.*
- Concrete forms in correct location.*
- Ground grid installation and two ground rods.*
- 36" radius at all 90° sweeps into pad stopping 1" above pad.*
- Secondary sweeps in place and proper number.*

AFTER POURING (after removing forms and prior to backfilling)

- Pad correctly formed and 10" high.*
- ¾" chamfer along the edges.*
- Sweeps 1" above pad.*

AFTER BACKFILLING

- 6" protective bollards are correctly installed.*
- Pad 5" above final grade.*
- Pad has 10' of clear space in front of transformer doors, is 10' from an accessible paved way and has the minimum clearance to other structures.*

*NOTE Y – Acceptable N – Deficient

36.0 Cable Installation Maximum Pull Chart

| Straight cable pull chart typical maximum pulls | | | | | | |
|---|--------------|-------------------|----------------------|--------------|-------------------|----------------------|
| Wire Size | 15kV Class | | | 35kV Class | | |
| | Riser to Pad | Riser to Pull Box | Pull box to Pull Box | Riser to Pad | Riser to Pull Box | Pull box to Pull Box |
| #2 AL | 530 | 605 | 750 | n.a. | n.a. | n.a. |
| 1/0 AL | n.a. | n.a. | n.a. | 320 | 360 | 750 |
| 2/0 CU | n.a. | n.a. | n.a. | 615 | 695 | 750 |
| 4/0 CU | 695 | 720 | 750 | n.a. | n.a. | n.a. |

Note:

- 1) All Calculations are based on a straight pulls
- 2) All conduits are 4"
- 3) Assume 50Lb reel drag
- 4) Assume .5 for coefficient of friction
- 5) Pulls are in feet
- 6) Pulls distances are shown from worst case pulling end.

37.0 Padmount Compartment Sealing Requirement

Issued by Standards #09-09

Safety
Standards
Work Methods

THREE PHASE PADMOUNTED TRANSFORMER SEALING

Padmounted transformer compartment areas shall be sealed to minimize the direct release of transformer fluid into the ground through the primary and secondary compartment areas of the transformer. Sealing the compartment areas will better contain the release, allowing the fluid to be noticed more promptly.

The following describes how to seal the compartments areas. Compartment areas shall be filled with sand to a grade of 4" below the top of the concrete pad. On top of the sand a concrete grout (no aggregate) or expanding foam (STD Item UF10) shall be installed to the top to the concrete pad. The installer of the transformer pad and conduit is required to seal the compartment areas. All conduits shall also be filled in with expanding foam. The customer is required to seal all conduits where they are installing customer owned cables, this includes the spare conduits in that duct bank. The company is required to seal all conduits where they are installing company owned cables, this includes the spare conduits in that duct bank. This detail is further explained in the Underground Construction Standards book in section 44.20. Note: Keep the expanding foam stored in a heated environment to make applying easier.




To seal spare conduit, install rag and fill with the expanding foam.



Grouted Area

Apply expanding foam in between all cables to form a complete seal.

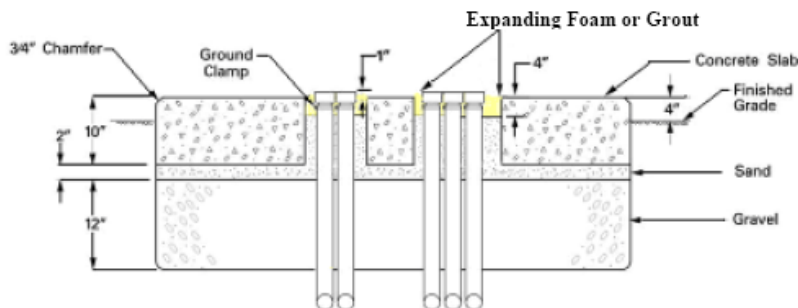

Cross section view of a padmounted transformer having primary and secondary compartments filled with sand and Expanding Foam.